#### STORMWATER MANAGEMENT REPORT

#### FOR

SOUTH ORANGE AVENUE REDEVELOPMENT BLOCK 1006, LOTS 1, 2, 3, 9, 10, 11, 13 & 14 VILLAGE OF SOUTH ORANGE ESSEX COUNTY, NEW JERSEY

#### SUBMITTED TO:

VILLAGE OF SOUTH ORANGE

#### PREPARED FOR:

HUB REALTY, LLC 447 NORTHFIELD AVENUE, SUITE 200 WEST ORANGE, NJ 07052

PREPARED BY:

PETRY ENGINEERING, LLC 155 PASSAIC AVENUE FAIRFIELD NJ 07004

**MARCH 26, 2020** 

#### STORMWATER MANAGEMENT REPORT

#### FOR

### SOUTH ORANGE AVENUE REDEVELOPMENT BLOCK 1006, LOTS 1, 2, 3, 9, 10, 11, 13 & 14 VILLAGE OF SOUTH ORANGE ESSEX COUNTY, NEW JERSEY

#### SUBMITTED TO:

#### VILLAGE OF SOUTH ORANGE

#### PREPARED FOR:

HUB REALTY, LLC 447 NORTHFIELD AVENUE, SUITE 200 WEST ORANGE, NJ 07052

PREPARED BY:

PETRY ENGINEERING, LLC 155 PASSAIC AVENUE FAIRFIELD NJ 07004

MARCH 26, 2020

J. Michael Petry, PE NJ PE #36662

#### INTRODUCTION

The existing site to be redeveloped fronts on South Orange Avenue, Vose Street, Taylor Place & Scotland Road. It consists of 8 tax lots that total 1.403 acres. The properties were previously developed with retail/office space and parking lots. The NRCS web soils survey mapping indicates that there are two types of soil on site. Urban Land Boonton Substratum, red sandstone (URBOOB) and Urban Lan Dunellen Substratum exist onsite, both of which are classified as Hydrologic Group "D" soils.

Lots 1, 2, 3, 9, 10, 11, 13 & 14 are to be combined and a mid-rise structure is to be constructed consisting of retail space, office space, apartments, and parking decks. The proposed development disturbs more than 1 acre, yet does not increase impervious surface by 0.25 acres. These improvements classify the site as a major development. As a result, a proposed stormwater management plan will be required. This plan will need to reduce the preconstruction runoff rates by 50%, 75%, and 80% for the 2, 10, and 100-year storms respectively.

#### METHODOLOGY

The USDA Natural Resources Conservation Service (NRCS) methodology described in the Technical Release 55 – Urban Hydrology for Small Water Sheds (TR-55) will be used for computing stormwater runoff rates, volumes and hydrographs for both existing and proposed conditions. In computing stormwater runoff from all design storms, the relative stormwater runoff rates and volumes of pervious and impervious surfaces will be analyzed separately. The rainfall-duration-frequency data was taken from the NOAA National Weather Service. Hydraflow Hydrographs Extension 2019 Modeling Software was used to compute the sites pre and post development runoff of the site.

#### EXISTING CONDITIONS

The site in existing conditions consists primarily of parking lots, buildings, and grass areas. We have reviewed the storm sewer mapping provided by the Village and spilt the site into two drainage areas. The northeastern portion of the site drains down Taylor Place and discharges into a catch basin that flow north of Vose Avenue. The southwestern portion of the site drains onto Vose Avenue and South Orange Avenue, meeting at the catch basins off Vose Avenue and heading west. The existing site was modeled using two (2) drainage areas consisting of 0.537 acres for drainage area one and 0.866 acres for drainage area two. (See Existing Drainage Area Map) The two drainage areas were then combined to determine the total runoff offsite. The total runoff, an area of 1.403 acres, was used during the proposed reduction calculations.

#### Drainage Area 1 (DA 1, Pervious)

Drainage Area 1 (Pervious Areas) consists of 0.053 acres with a composite CN value of 80 (Open Spaces-Lawn, Good). Slopes in this area are between 2 to 9%. This area presently drains to Taylor Place and flows down to the Vose Avenue catch basins. A Tc of 10 minutes will be used, which is reflective of the existing land cover and slopes on the site.

#### Drainage Area 1 (DA 1, Impervious)

Drainage Area 1 (Impervious Areas) consists of 0.484 acres with a CN value of 98 (Paved Parking Lots and Roofs). Slopes in this area range from 2% to 5%. This area presently drains to Taylor Place and flows down to the Vose Avenue catch basins. A Tc of 10 minutes will be used, which is reflective of the existing land cover and slopes on the site.

#### Drainage Area 2 (DA 2, Pervious)

Drainage Area 2 (Pervious Areas) consists of 0.062 acres with a composite CN value of 80 (Open Spaces-Lawn, Good). Slopes in this area are between 2 to 44%. This area presently drains to catch basins located near the intersection of Vose Avenue and South Orange Avenue and then heads west. A Tc of 10 minutes will be used, which is reflective of the existing land cover and slopes on the site.

#### Drainage Area 2 (DA 2, Impervious)

Drainage Area 2 (Impervious Areas) consists of 0.804 acres with a CN value of 98 (Paved Parking Lots and Roofs). Slopes in this area range from 2% to 5%. This area presently drains to catch basins located near the intersection of Vose Avenue and South Orange Avenue and then heads west. A Tc of 10 minutes will be used, which is reflective of the existing land cover and slopes on the site.

### Post-Development Target Runoff

The CN values used have been taken from the TR-55 Manual "Urban Hydrology for Small Watersheds", Table 2-2a Runoff Curve Numbers for Urban Areas. For Open Spaces-Lawn (CN 80), and Paved Parking Lots and Roofs (CN 98), all for Hydrologic Soil Group D Soils. Since the site is considered a major development, proposed runoff rates shall be reduced from the preconstruction runoff rates by 50%, 75% and 80%. The total offsite runoff, a combination of drainage area one and two, was used for these calculations.

Table 1 - Target Runoff Rates

Storm Event (Yr.)	Existing Runoff Rates (cfs)	Total Post-Development Target Runoff (cfs)
2 Year	3.017 cfs	1.508 cfs
10 Year	4.703 cfs	3.527 cfs
100 Year	8.009 cfs	6.407 cfs

#### PROPOSED CONDITIONS

Improvements to the site will consist of the construction of a mid-rise building that will contain residential, retail, and office space while providing two levels of parking decks. The subsurface detention system will attenuate the flows from the site improvements.

The same 1.403-acre drainage area was used to analyze proposed conditions runoff (See Proposed Drainage Area Map). Every attempt was made to keep the proposed drainage patterns similar to those of the existing conditions where possible. The drainage areas are described below:

#### Drainage Area 1 (DA 1), To Detention System

Drainage Area 1 consists of the total area that drains into the detention system located under the parking deck, parallel to Vose Avenue. It includes a majority of the impervious areas on site, capturing 0.955 acres of roof area. A Tc of 10 minutes will be used, which is the minimum time of concentration for the Type D storm distribution.

### Drainage Area 2 (DA 2), Bypass

A small portion of the building, fronting on South Orange Avenue, will bypass the Detention Basin. The total area of Drainage Area 2 consists of 0.448 acres of roof areas. Again, a Tc of 10 minutes will be used, which is the minimum time of concentration for the Type D storm distribution.

#### WATER QUANTITY

In order to meet the runoff requirements for the 2, 10 and 100-year storm events, a detention system was incorporated for water quantity.

#### **Detention System**

This detention system will contain 5,472 cubic feet of storage contained in 3' diameter pipes. It will be used for water quantity. The bottom elevation of the 3' Diameter HDPE pipe is at elevation 150.50, and the bottom of the stone encasement is at elevation 150.00. The system consists of three 250-foot lengths of 3' diameter pipe (w/ headers), with one and a half feet of clean crushed stone on each side of the system and half a foot of clean crushed stone on the bottom, and one foot of clean crushed stone on the top of the system. Filter fabric surrounds the stone encasement on each side and the top. The site is located within a Metropolitan Planning Area, therefore, no groundwater recharge is required.

The bottom of the basin will be set at elevation 150.50 while Outlet Structure #1 will have three 2.5" orifices at elevation 150.50, a 6" x 20" rectangular orifice at elevation 152.00 and a 4' wide overflow weir at elevation 153.17.

The CN value used for proposed conditions have been taken from the TR-55 Manual "Urban Hydrology for Small Watersheds", Table 2-2a for Paved Parking Lots, Roofs, Driveways (CN 98), as the entire site will be impervious in proposed conditions. As a result of the proposed design, the water quantity requirements for the proposed development have been met. See Table 2 below:

Table 2 - Proposed Target Runoff Rate Comparisons

Storm Event (Yr.)	Total Post-Development Target Runoff (cfs)	Total Proposed Runoff (cfs)
2 Year	1.508 cfs	1.491 cfs
10 Year	3.527 cfs	3.203 cfs
100 Year	6.407 cfs	6.366 cfs

#### WATER RECHARGE & QUALITY

South Oranges' Stormwater Control Ordinance 185-102 states that groundwater recharge is not required for projects within the Urban Redevelopment area, which this site is located in. It goes further to state that runoff quality standards are not required unless ¼ acre of impervious surface is being proposed, which is not in this case.

#### GROUNDWATER

A report prepared by Geotechnical Engineering Services, PC has determined that the groundwater in the vicinity of the detention basin is at roughly elevation 136.9. This is roughly 13.5 feet below the proposed system.

#### **DRAIN TIMES**

The drainage time of the system is below 72 hours:

Detention System - Drains in 26.00 hrs.


See attached Elevation vs Time Hydrographs for more information.

#### CONCLUSION

To summarize, a stormwater management strategy has been incorporated to satisfy water quantity requirements of the Village of South Orange. The flows have been controlled such that the water runoff is 50%, 75% and 80% of the preconstruction runoff rates for the 2, 10- and 100-year storms.

# HYDROGRAPH EXISTING CONDITIONS

# Watershed Model Schematic Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

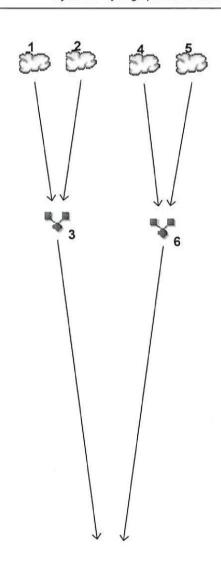



#### Legend

Hyd.	<u>Origin</u>	Description
1	SCS Runoff	DA1 Pervious
2	SCS Runoff	<b>DA1 Impervious</b>
3	Combine	<no description=""></no>
4	SCS Runoff	DA2 Pervious
5	SCS Runoff	DA2 Impervious
6	Combine	<no description=""></no>
7	Combine	<no description=""></no>

Project: Existing DA1.gpw

Friday, 03 / 20 / 2020

Friday, 03 / 20 / 2020

Watershed Model Schematic	1
Hydrograph Return Period Recap	. 2
2 - Year	
Summary Report	. 3
Hydrograph Reports	
Hydrograph No. 1, SCS Runoff, DA1 Pervious	
Hydrograph No. 2, SCS Runoff, DA1 Impervious	
Hydrograph No. 3, Combine, <no description=""></no>	
Hydrograph No. 4, SCS Runoff, DA2 Pervious	
Hydrograph No. 5, SCS Runoff, DA2 Impervious	
Hydrograph No. 6, Combine, <no description=""></no>	
Hydrograph No. 7, Combine, <no description=""></no>	
10 - Year	
Summary Report	11
Hydrograph Reports	12
Hydrograph No. 1, SCS Runoff, DA1 Pervious	
Hydrograph No. 2, SCS Runoff, DA1 Impervious	
Hydrograph No. 3, Combine, <no description=""></no>	
Hydrograph No. 4, SCS Runoff, DA2 Pervious	
Hydrograph No. 5, SCS Runoff, DA2 Impervious	
Hydrograph No. 6, Combine, <no description=""></no>	
Hydrograph No. 7, Combine, <no description=""></no>	
25 - Year	
Summary Report	19
Hydrograph Reports	20
Hydrograph No. 1, SCS Runoff, DA1 Pervious	
Hydrograph No. 2, SCS Runoff, DA1 Impervious	
Hydrograph No. 3, Combine, <no description=""></no>	
Hydrograph No. 4, SCS Runoff, DA2 Pervious	
Hydrograph No. 5, SCS Runoff, DA2 Impervious	
Hydrograph No. 6, Combine, <no description=""></no>	
Hydrograph No. 7, Combine, <no description=""></no>	
100 - Year	
Summary Report	27
Hydrograph Reports	
Hydrograph No. 1, SCS Runoff, DA1 Pervious	28
Hydrograph No. 2, SCS Runoff, DA1 Impervious	
Hydrograph No. 3, Combine, <no description=""></no>	
Hydrograph No. 4, SCS Runoff, DA2 Pervious	
Hydrograph No. 5, SCS Runoff, DA2 Impervious	32
Hydrograph No. 6, Combine, <no description=""></no>	

_						
Cor	าten	te	COL	ntır	LIAC	
$\sim$ 01	II CIII	LO		ILII	IUCU	

Existin		D 4 4	-
EXISTI	ıu		wap.

Hydrograph No. 7, Combine, <no description=""></no>	34
IDF Report	35

# Hydrograph Return Period Recap Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

	Hydrograph	Inflow				Peak Ou	tflow (cfs	)			Hydrograph
lo.	type (origin)	hyd(s)	1-yr	2-yr	3-yr	5-yr	10-yr	25-yr	50-yr	100-yr	Description
1	SCS Runoff			0.065		200000	0.129	0.175		0.260	DA1 Pervious
2	SCS Runoff			1.080			1.662	2.064		2.798	DA1 Impervious
3	Combine	1, 2		1.146			1.791	2.239		3.058	<no description=""></no>
4	SCS Runoff			0.077			0.151	0.205		0.304	DA2 Pervious
5	SCS Runoff			1.795			2.761	3.428		4.648	DA2 Impervious
6	Combine	4, 5		1.871			2.912	3.633		4.951	<no description=""></no>
7	Combine	3, 6		3.017			4.703	5.871		8.009	<no description=""></no>
								,			
#						5			18		13.1

Proj. file: Existing DA1.gpw

Friday, 03 / 20 / 2020

# Hydrograph Summary Report Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description
1	SCS Runoff	0.065	6	732	279	-	738.5744.9 	<u></u>	DA1 Pervious
2	SCS Runoff	1.080	6	732	5,200				DA1 Impervious
3	Combine	1.146	6	732	5,479	1, 2			<no description=""></no>
4	SCS Runoff	0.077	6	732	327				DA2 Pervious
5	SCS Runoff	1,795	6	732	8,637				DA2 Impervious
6	Combine	1.871	6	732	8,964	4, 5			<no description=""></no>
7	Combine	3.017	6	732	14,443	3, 6	*****		<no description=""></no>
								*	
							N.		
Exi	sting DA1.gp	)w		11	Return	Period: 2 Y	ear	Friday, 03	/ 20 / 2020

Friday, 03 / 20 / 2020


## Hyd. No. 1

**DA1 Pervious** 

Hydrograph type = SCS Runoff Peak discharge = 0.065 cfsStorm frequency = 2 yrs Time to peak = 732 min Hyd. volume Time interval = 6 min = 279 cuft Curve number Drainage area = 0.053 ac= 80 Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc)  $= 10.00 \, \text{min}$ = User

Total precip. = 3.39 in Distribution = Custom

Storm duration = S:\Petry Engineering ResourceHaipeefaytetormwater\Stoff84 Distributions\NJ-Tyr

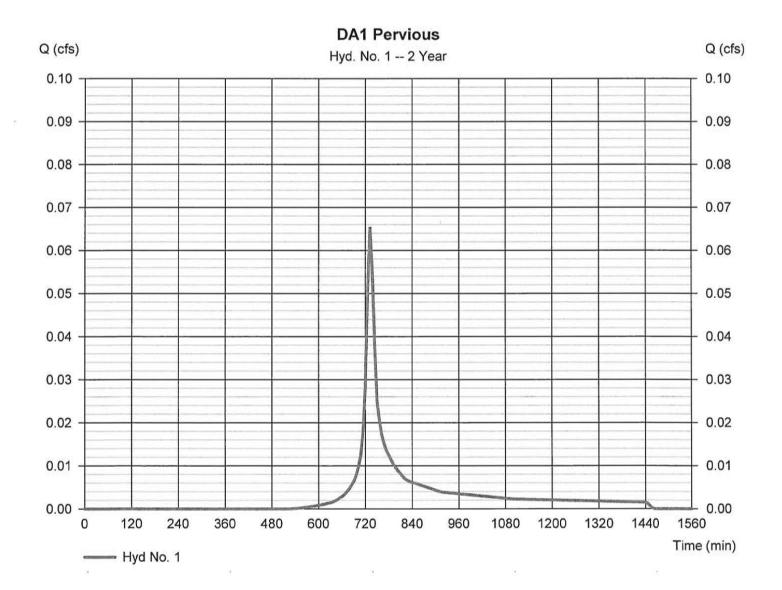

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020

## Hyd. No. 2


**DA1** Impervious

Peak discharge = 1.080 cfsHydrograph type = SCS Runoff Storm frequency = 2 yrs Time to peak = 732 min Hyd. volume Time interval = 5,200 cuft= 6 min Curve number = 0.484 ac= 98 Drainage area

Hydraulic length Basin Slope = 0.0 %= 0 ft

Time of conc. (Tc) Tc method = User  $= 10.00 \, \text{min}$ Distribution = Custom Total precip. = 3.39 in

Storm duration = S:\Petry Engineering ResourceHaipeafactormwater\Stoft84 Distributions\NJ-Tyr

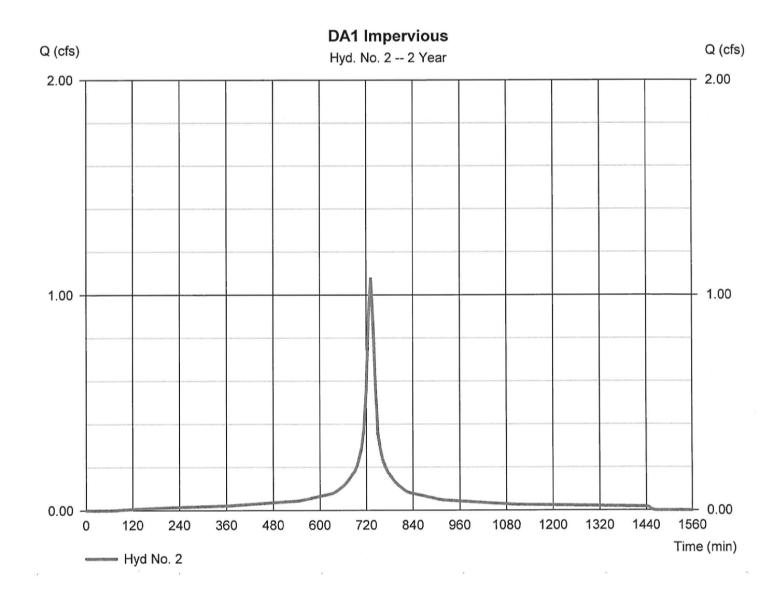

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 03 / 20 / 2020

## Hyd. No. 3

<no description>

Hydrograph type = Combine
Storm frequency = 2 yrs
Time interval = 6 min
Inflow hyds. = 1, 2

Peak discharge = 1.146 cfs
Time to peak = 732 min
Hyd. volume = 5,479 cuft
Contrib. drain. area = 0.537 ac

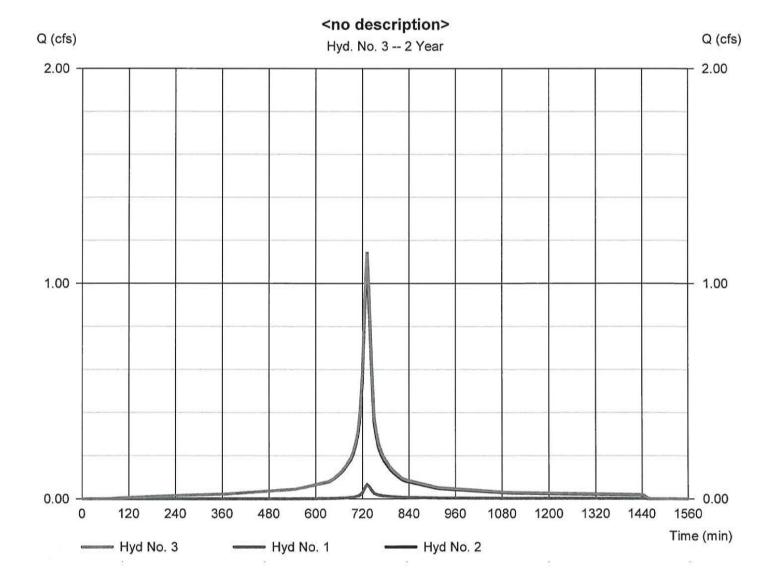

Friday, 03 / 20 / 2020


## Hyd. No. 4

**DA2 Pervious** 

Hydrograph type = SCS Runoff Peak discharge = 0.077 cfsStorm frequency = 2 yrsTime to peak = 732 min Time interval = 6 min Hyd. volume = 327 cuft = 0.062 acCurve number Drainage area = 80 Basin Slope Hydraulic length = 0.0 %= 0 ft

Tc method = User Time of conc. (Tc) = 10.00 min
Total precip. = 3.39 in Distribution = Custom

Storm duration = S:\Petry Engineering Resourcehalpedra/comwater\Stormwater\St

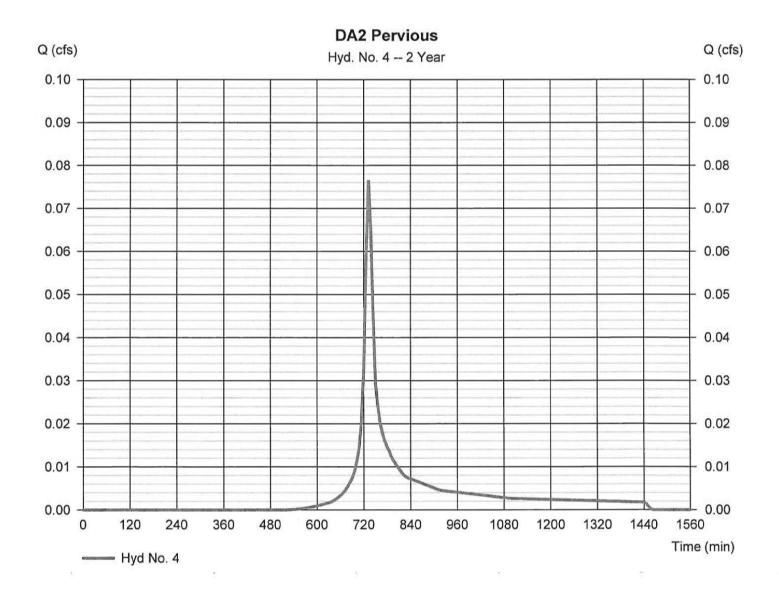

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

= 3.39 in

Friday, 03 / 20 / 2020

= Custom

## Hyd. No. 5


Total precip.

**DA2 Impervious** 

= 1.795 cfsHydrograph type = SCS Runoff Peak discharge Storm frequency = 2 yrsTime to peak = 732 min Time interval Hyd. volume = 8,637 cuft = 6 min = 0.804 acCurve number = 98 Drainage area Hydraulic length = 0 ftBasin Slope = 0.0 %Time of conc. (Tc) = User Tc method  $= 10.00 \, \text{min}$ 

Storm duration = S:\Petry Engineering Resourcehaipedra/Stormwater\

Distribution

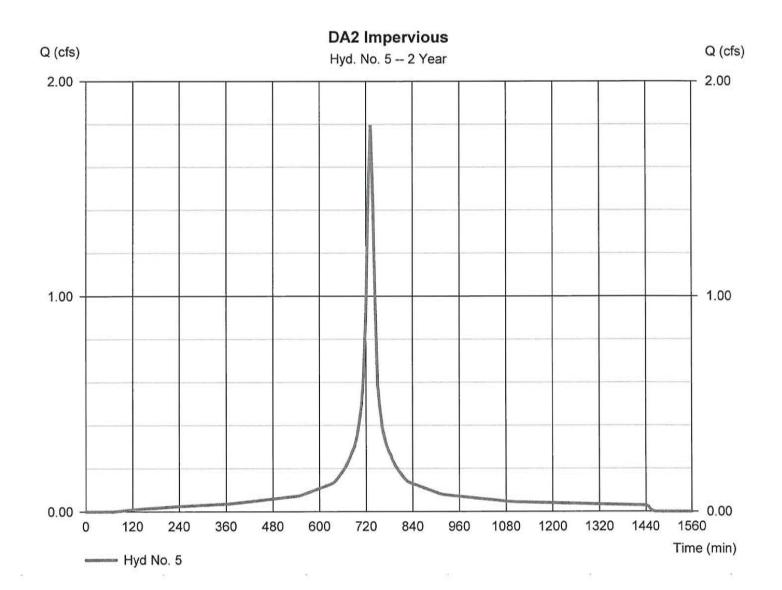

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020

## Hyd. No. 6

<no description>

Hydrograph type Storm frequency Time interval Inflow hyds. = Combine = 2 yrs


= 2 yrs = 6 min = 4, 5 Peak discharge

= 1.871 cfs

Time to peak Hyd. volume = 732 min = 8,964 cuft

Contrib. drain. area

= 0.866 ac

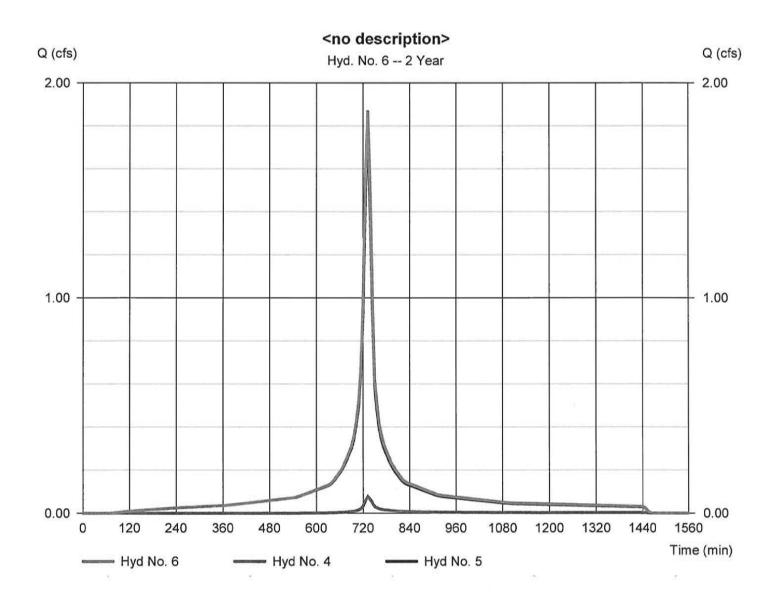

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020

## Hyd. No. 7

<no description>


Hydrograph type Storm frequency Time interval Inflow hyds. = Combine

= 2 yrs = 6 min = 3, 6 Peak discharge Time to peak = 3.017 cfs = 732 min

Hyd. volume

= 14,443 cuft

Contrib. drain. area = 0.000 ac

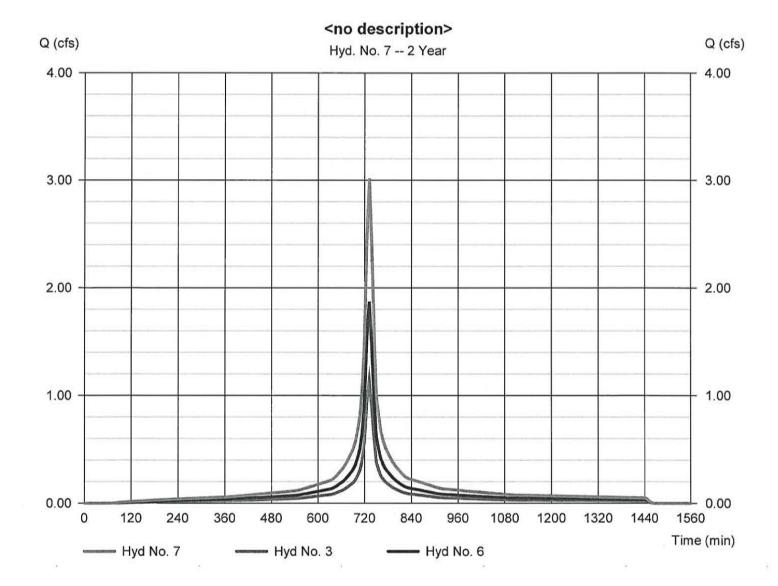

# Hydrograph Summary Report Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description
1	SCS Runoff	0.129	6	732	550				DA1 Pervious
2	SCS Runoff	1.662	6	732	8,142				DA1 Impervious
3	Combine	1.791	6	732	8,692	1, 2			<no description=""></no>
4	SCS Runoff	0.151	6	732	644				DA2 Pervious
5	SCS Runoff	2.761	6	732	13,524				DA2 Impervious
6	Combine	2.912	6	732	14,168	4, 5			<no description=""></no>
7	Combine	4.703	6	732	22,860	3, 6			<no description=""></no>
		,					,		
Exi	sting DA1.gpv	W			Return F	Period: 10	Year	Friday, 03	20 / 2020

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020


## Hyd. No. 1

**DA1 Pervious** 

Hydrograph type = SCS Runoff Peak discharge = 0.129 cfsTime to peak Storm frequency = 10 yrs= 732 min Hyd. volume Time interval = 6 min = 550 cuft = 0.053 acCurve number = 80 Drainage area Hydraulic length Basin Slope = 0.0 %= 0 ft

Tc method = User Time of conc. (Tc) = 10.00 min
Total precip. = 5.18 in Distribution = Custom

Storm duration = S:\Petry Engineering ResourceHaipeefaytettormwater\Stoff84 Distributions\NJ-Tyr

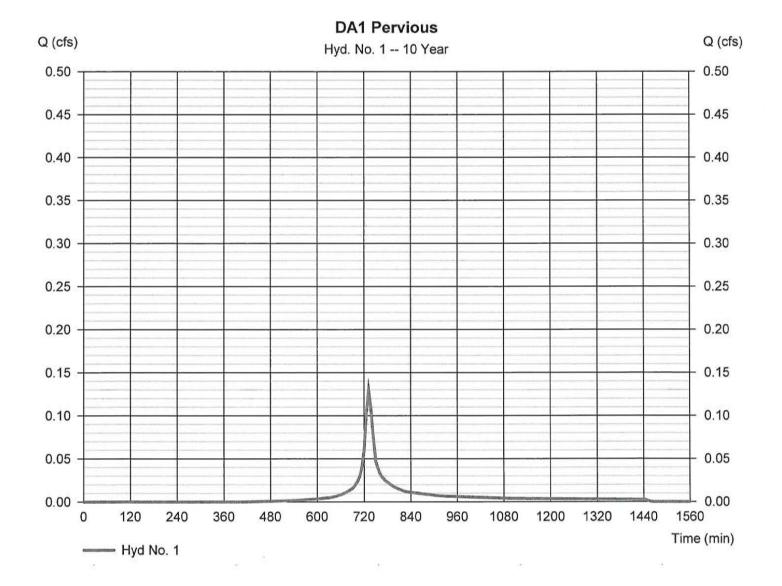

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 03 / 20 / 2020

## Hyd. No. 2

### **DA1** Impervious

= 1.662 cfsHydrograph type = SCS Runoff Peak discharge Storm frequency = 10 yrsTime to peak = 732 min Hyd. volume Time interval = 6 min = 8,142 cuft Curve number = 0.484 ac= 98 Drainage area Hydraulic length Basin Slope = 0.0 %= 0 ftTime of conc. (Tc) Tc method = User  $= 10.00 \, \text{min}$ Distribution Total precip. = 5.18 in= Custom

Storm duration = S:\Petry Engineering ResourceHaipeafaytetormwater\Stoff84 Distributions\NJ-Tyr

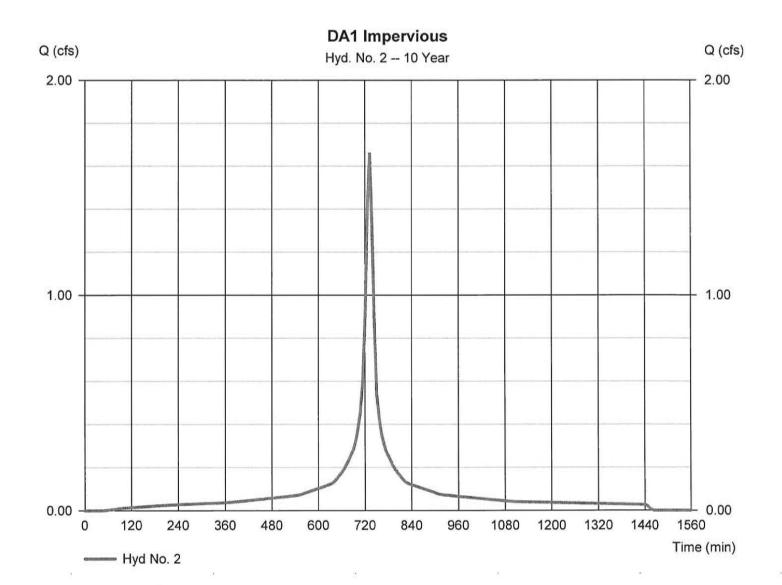

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020

## Hyd. No. 3

<no description>

Hydrograph type Storm frequency Time interval Inflow hyds. = Combine

= 10 yrs = 6 min

= 1, 2


Peak discharge

= 1.791 cfs

Time to peak Hyd. volume = 732 min = 8,692 cuft

Contrib. drain. area

= 0.537 ac

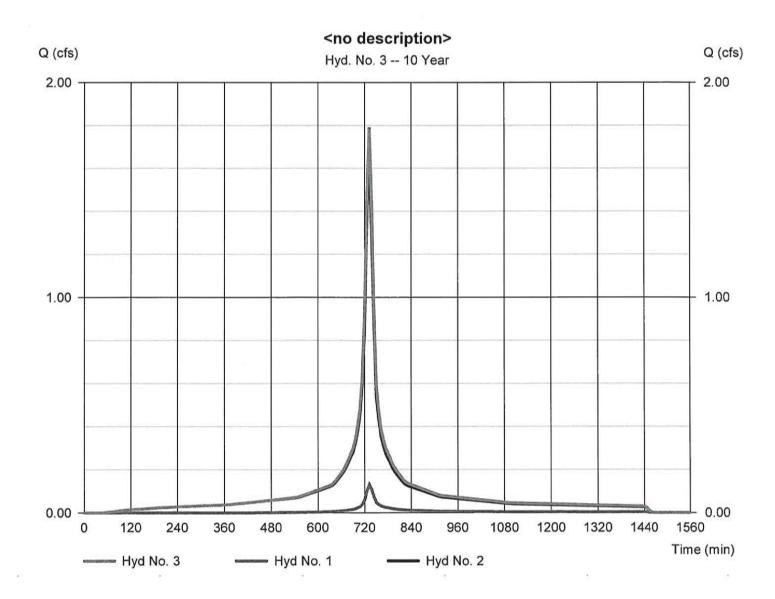

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020


## Hyd. No. 4

**DA2 Pervious** 

= 0.151 cfsHydrograph type = SCS Runoff Peak discharge Storm frequency = 10 yrsTime to peak = 732 min Time interval = 6 min Hyd. volume = 644 cuft Drainage area = 0.062 acCurve number = 80 Hydraulic length Basin Slope = 0 ft= 0.0 %Time of conc. (Tc) Tc method = User  $= 10.00 \, \text{min}$ 

Total precip. = 5.18 in Distribution = Custom

Storm duration = S:\Petry Engineering Resourcehaipefig\text{Stormwater\Stoff84 Distributions\NJ-Tyr.}

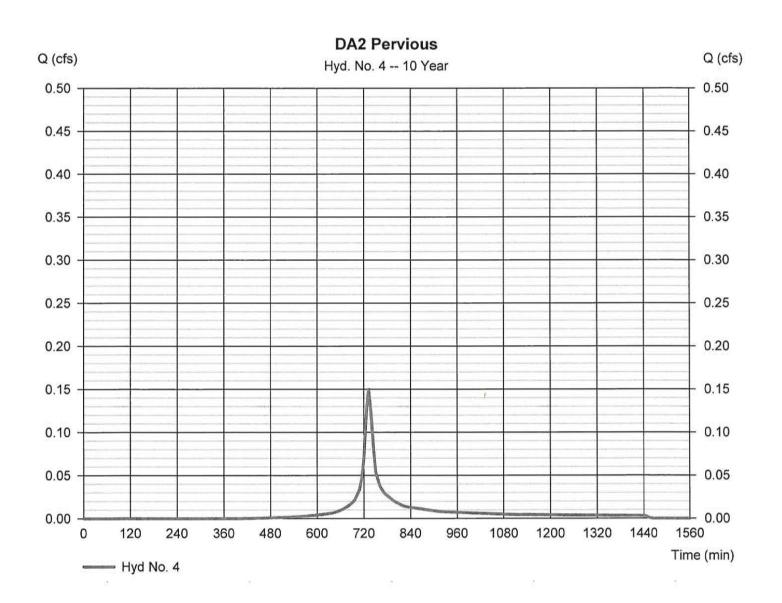

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020

## Hyd. No. 5

**DA2 Impervious** 

Hydrograph type = SCS Runoff
Storm frequency = 10 yrs
Time interval = 6 min
Drainage area = 0.804 ac

Basin Slope = 0.0 %
Tc method = User
Total precip. = 5.18 in


Storm duration

Peak discharge = 2.761 cfs Time to peak = 732 min

Hyd. volume = 13,524 cuft
Curve number = 98

Hydraulic length = 0 ft Time of conc. (Tc) = 10.00 min

= 5.18 in Distribution = Custom = S:\Petry Engineering ResourceHaiperfactormwater\Stof64 Distributions\NJ-Tyr

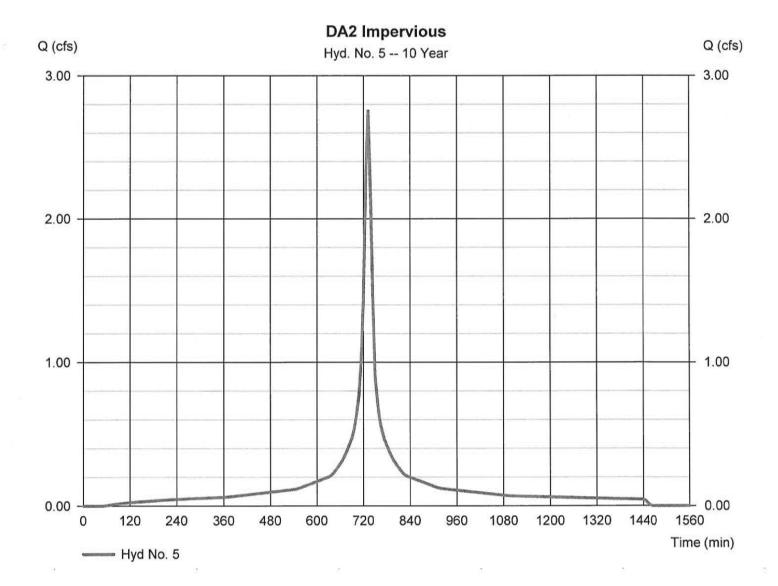

Friday, 03 / 20 / 2020

## Hyd. No. 6

<no description>

Hydrograph type Storm frequency Time interval Inflow hyds.

= Combine = 10 yrs

= 10 yrs = 6 min = 4, 5 Peak discharge


= 2.912 cfs = 732 min

Time to peak Hyd. volume

= 14,168 cuft

Contrib. drain. area

= 0.866 ac

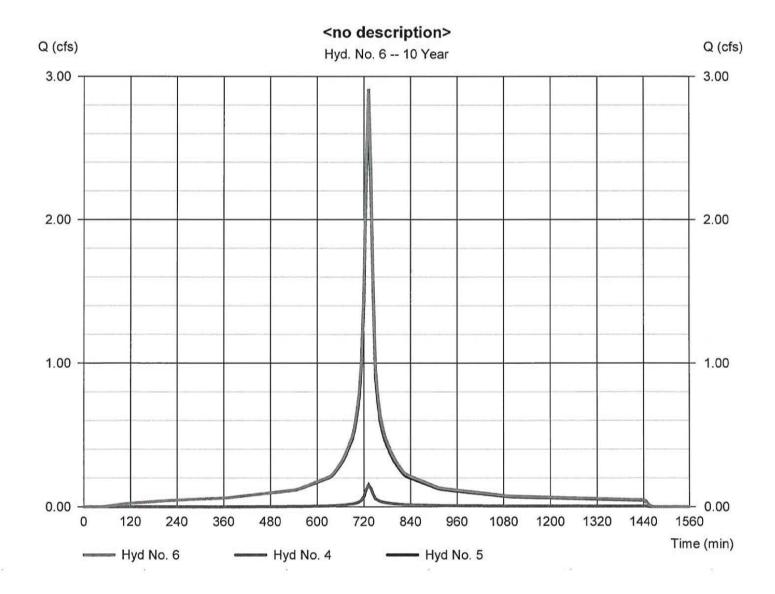


Friday, 03 / 20 / 2020

## Hyd. No. 7

<no description>

Hydrograph type = Combine Storm frequency = 10 yrs Time interval = 6 min Inflow hyds. = 3, 6 Peak discharge = 4.703 cfs
Time to peak = 732 min
Hyd. volume = 22,860 cuft
Contrib. drain. area = 0.000 ac

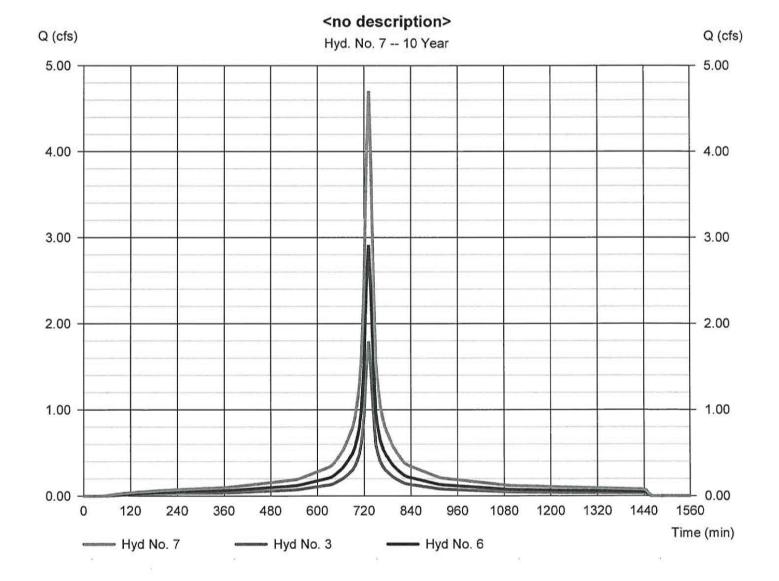

# Hydrograph Summary Report Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description
1	SCS Runoff	0.175	6	732	751			# <u>5/10/8-50</u>	DA1 Pervious
2	SCS Runoff	2.064	6	732	10,181				DA1 Impervious
3	Combine	2.239	6	732	10,932	1, 2			<no description=""></no>
4	SCS Runoff	0.205	6	732	878			-	DA2 Pervious
5	SCS Runoff	3.428	6	732	16,913				DA2 Impervious
6	Combine	3.633	6	732	17,791	4, 5	******	******	<no description=""></no>
7	Combine	5.871	6	732	28,723	3, 6			<no description=""></no>
3					ğ		2		
Exi	sting DA1.gp	w	At		Return F	Period: 25	Year	Friday, 03	/ 20 / 2020

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020


## Hyd. No. 1

**DA1** Pervious

Peak discharge Hydrograph type = SCS Runoff = 0.175 cfsTime to peak Storm frequency = 732 min = 25 yrsTime interval Hyd. volume = 751 cuft = 6 min Drainage area = 0.053 acCurve number = 80 Basin Slope Hydraulic length = 0 ft= 0.0 %Time of conc. (Tc) Tc method = User  $= 10.00 \, \text{min}$ 

Total precip. = 6.42 in Distribution = Custom

Storm duration = S:\Petry Engineering ResourceHaipedfaycomwater\Stoff84 Distributions\NJ-Tyr

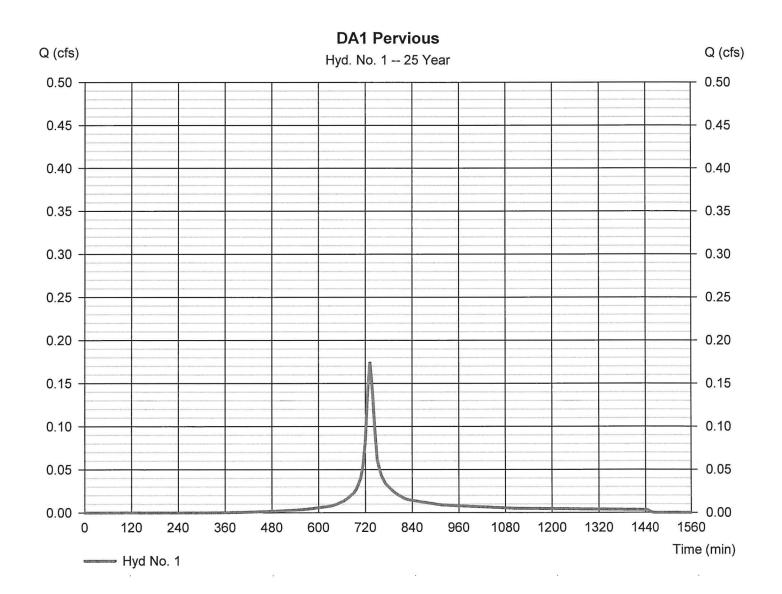


Friday, 03 / 20 / 2020

## Hyd. No. 2

### **DA1** Impervious

= 2.064 cfsHydrograph type = SCS Runoff Peak discharge Storm frequency = 25 yrsTime to peak = 732 min Hyd. volume Time interval = 6 min = 10,181 cuftCurve number Drainage area = 0.484 ac= 98 Basin Slope Hydraulic length = 0.0 %= 0 ftTime of conc. (Tc) Tc method = User  $= 10.00 \, \text{min}$ Distribution Total precip. = 6.42 in= Custom

Storm duration = S:\Petry Engineering ResourceHaipeefaytetormwater\Stoff84 Distributions\NJ-Tyr

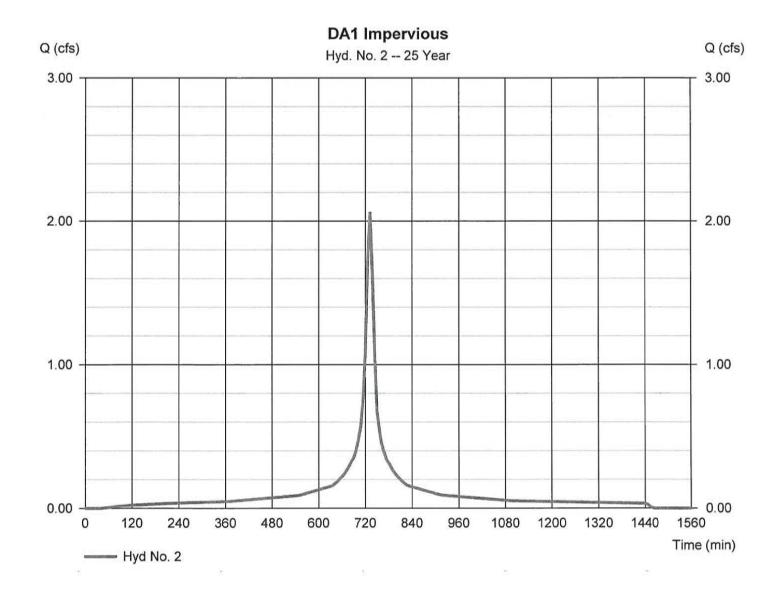

Friday, 03 / 20 / 2020

## Hyd. No. 3

<no description>

Hydrograph type Storm frequency Time interval Inflow hyds.

= Combine

= 25 yrs


= 6 min = 1, 2

Peak discharge

= 2.239 cfs= 732 min

Time to peak Hyd. volume = 10,932 cuft

Contrib. drain. area = 0.537 ac

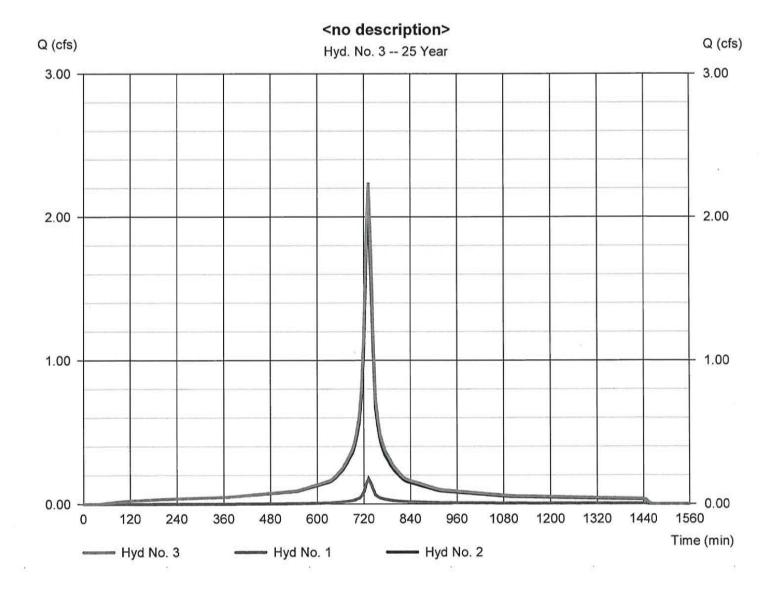

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020


## Hyd. No. 4

**DA2 Pervious** 

Hydrograph type = SCS Runoff Peak discharge = 0.205 cfsStorm frequency = 25 yrsTime to peak = 732 min Hyd. volume Time interval = 6 min = 878 cuft Curve number Drainage area = 0.062 ac= 80 Basin Slope Hydraulic length = 0.0 %= 0 ft

Tc method = User Time of conc. (Tc) = 10.00 min
Total precip. = 6.42 in Distribution = Custom

Storm duration = S:\Petry Engineering ResourceHaipeafay\textstormwater\Stormw

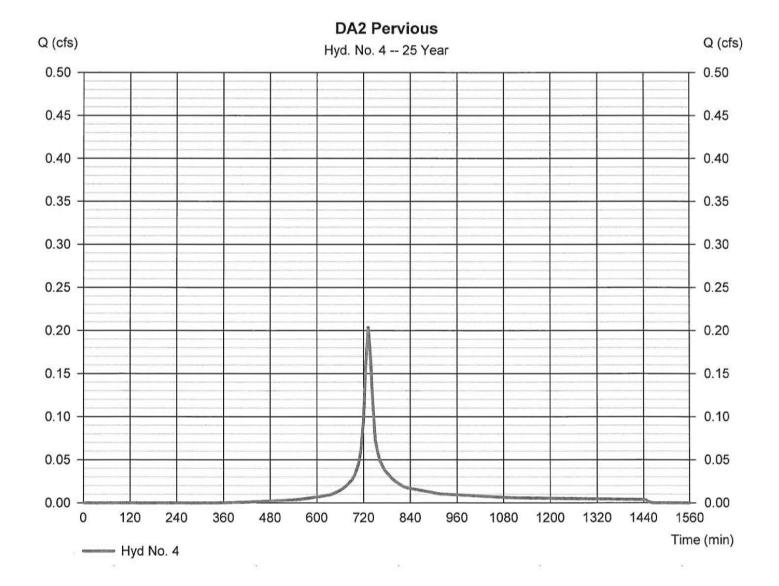

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020


## Hyd. No. 5

### **DA2 Impervious**

Hydrograph type = SCS Runoff Peak discharge = 3.428 cfsTime to peak Storm frequency = 25 yrs= 732 min Time interval Hyd. volume = 16,913 cuft = 6 min Curve number = 98 Drainage area = 0.804 acHydraulic length Basin Slope = 0.0 %= 0 ft

Tc method = User Time of conc. (Tc) = 10.00 min
Total precip. = 6.42 in Distribution = Custom

Storm duration = S:\Petry Engineering Resourcehaipeafay\text{Stormwater\Stoff84 Distributions\NJ-Tyr}

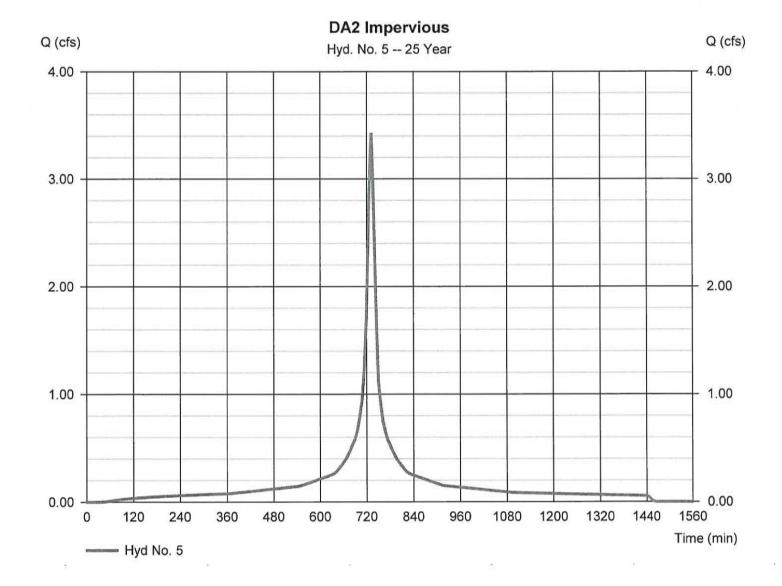

Friday, 03 / 20 / 2020

## Hyd. No. 6

<no description>

Hydrograph type Storm frequency Time interval

Inflow hyds.

= Combine

= 25 yrs= 6 min


= 4, 5

Peak discharge Time to peak

= 3.633 cfs= 732 min = 17,791 cuft

Hyd. volume Contrib. drain. area

= 0.866 ac

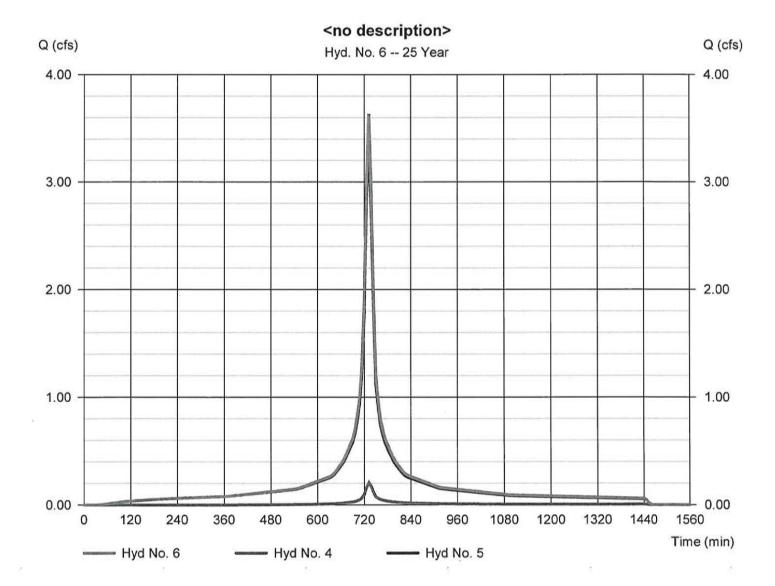

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020

## Hyd. No. 7

<no description>

Hydrograph type Storm frequency Time interval

Inflow hyds.

= Combine

= 25 yrs = 6 min

= 3, 6

Peak discharge


= 5.871 cfs

Time to peak Hyd. volume

= 732 min = 28,723 cuft

Contrib. drain. area

= 0.000 ac

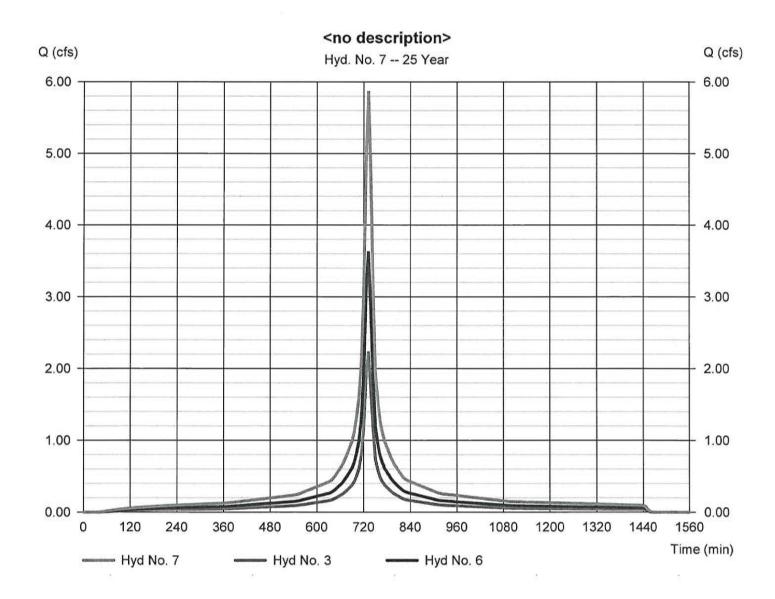

Hydrograph Summary Report
Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

lyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description
1	SCS Runoff	0.260	6	732	1,132	121.000			DA1 Pervious
2	SCS Runoff	2.798	6	732	13,918				DA1 Impervious
3	Combine	3.058	6	732	15,049	1, 2			<no description=""></no>
4	SCS Runoff	0.304	6	732	1,324	01 (01 P 2 V) 10 00 0 V 01	-		DA2 Pervious
5	SCS Runoff	4.648	6	732	23,120				DA2 Impervious
6	Combine	4.951	6	732	24,443	4, 5			<no description=""></no>
7	Combine	8.009	6	732	39,493	3, 6			<no description=""></no>
			*						5

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 03 / 20 / 2020

## Hyd. No. 1

**DA1** Pervious

= SCS Runoff = 0.260 cfsHydrograph type Peak discharge Storm frequency = 100 yrsTime to peak = 732 min Time interval = 6 min Hyd. volume = 1,132 cuft = 0.053 acCurve number = 80 Drainage area Basin Slope Hydraulic length = 0 ft= 0.0 %Time of conc. (Tc) Tc method = User  $= 10.00 \, \text{min}$ Distribution Total precip. = 8.69 in= Custom

Storm duration = S:\Petry Engineering ResourceHalperfactormwater\S

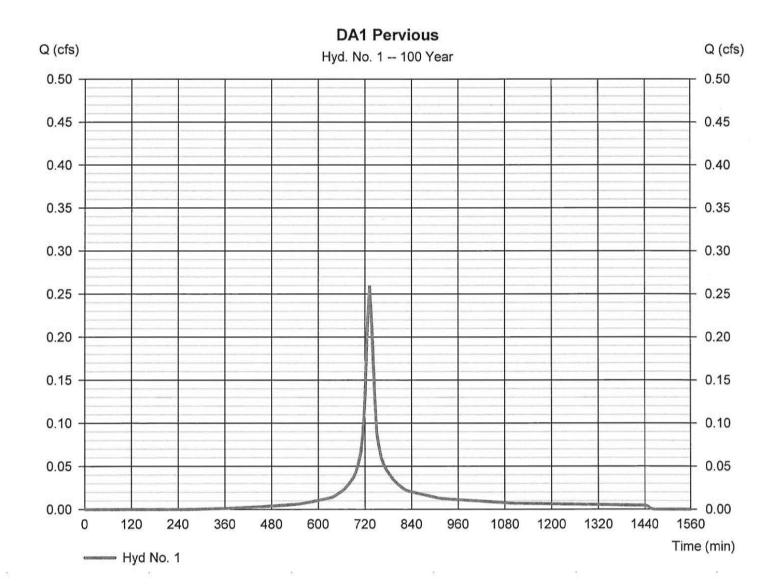

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 03 / 20 / 2020

## Hyd. No. 2

### **DA1** Impervious

= SCS Runoff Hydrograph type Peak discharge = 2.798 cfsStorm frequency = 100 yrsTime to peak = 732 min Hyd. volume Time interval = 6 min = 13,918 cuft Curve number = 0.484 ac= 98 Drainage area Basin Slope Hydraulic length = 0.0 %= 0 ftTime of conc. (Tc) Tc method = User  $= 10.00 \, \text{min}$ Distribution Total precip. = 8.69 in= Custom

Storm duration = S:\Petry Engineering Resourcehaipeafaytetormwater\Stormwater

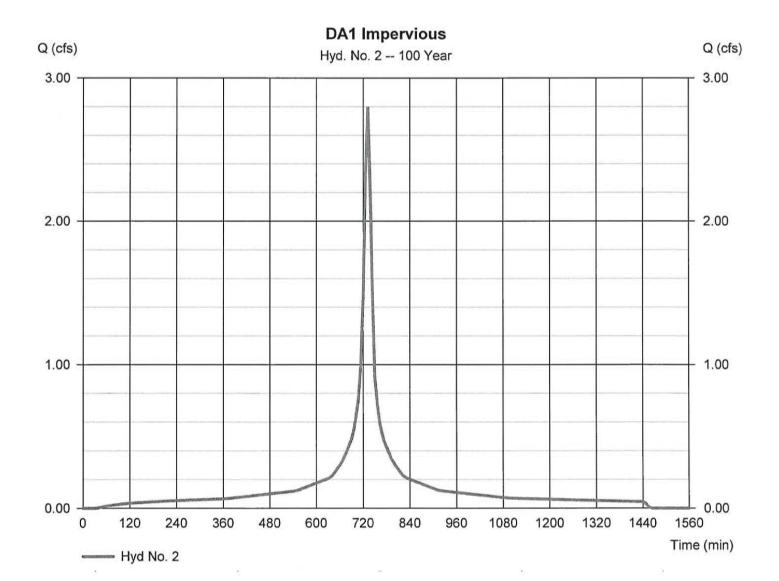


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020

## Hyd. No. 3

<no description>

Hydrograph type = Combine Storm frequency = 100 yrs Time interval = 6 min Inflow hyds. = 1, 2 Peak discharge = 3.058 cfs
Time to peak = 732 min
Hyd. volume = 15,049 cuft
Contrib. drain. area = 0.537 ac

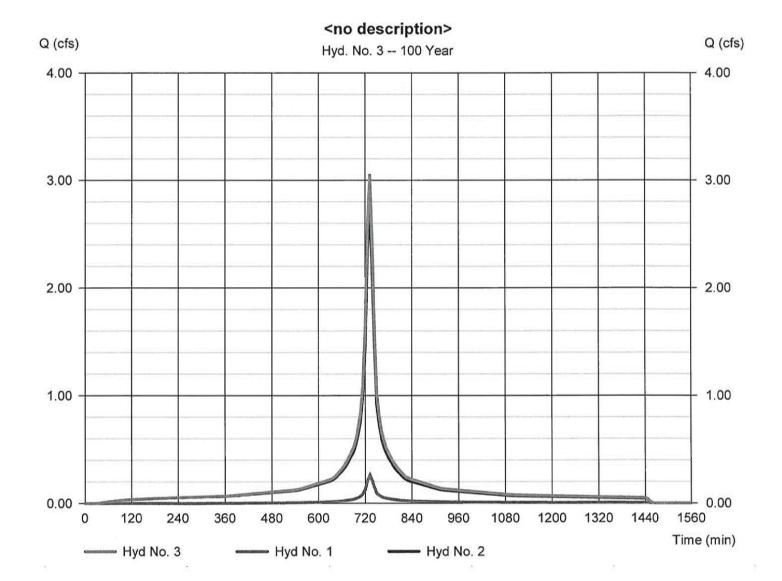

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020


### Hyd. No. 4

**DA2 Pervious** 

= 0.304 cfsHydrograph type = SCS Runoff Peak discharge Storm frequency = 100 yrsTime to peak = 732 min Hyd. volume Time interval = 6 min = 1,324 cuft = 0.062 acCurve number = 80 Drainage area Basin Slope Hydraulic length = 0 ft= 0.0 %Time of conc. (Tc) Tc method = User  $= 10.00 \, \text{min}$ 

Total precip. = 8.69 in Distribution = Custom

Storm duration = S:\Petry Engineering Resourcehaipeafay\text{Stormwater\Storm

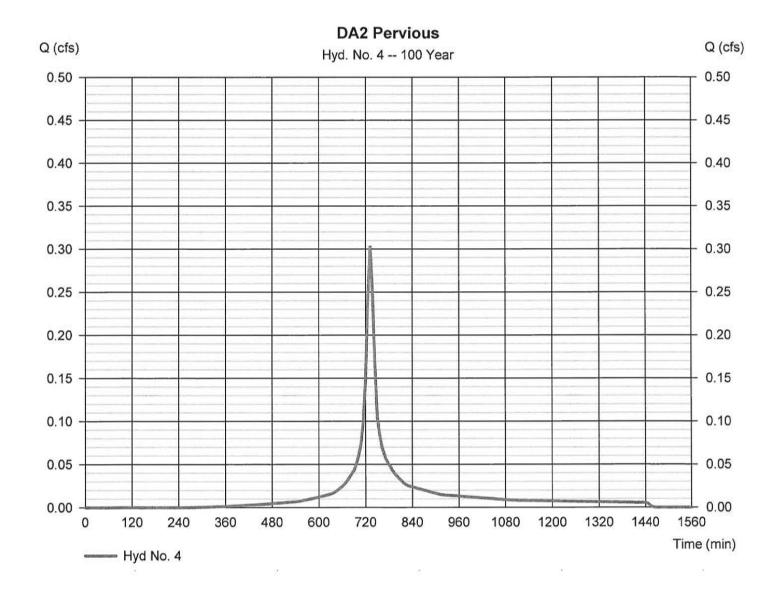

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020


## Hyd. No. 5

**DA2 Impervious** 

Hydrograph type = SCS Runoff Peak discharge = 4.648 cfsStorm frequency Time to peak = 732 min = 100 yrsTime interval Hyd. volume = 23,120 cuft = 6 min Curve number Drainage area = 0.804 ac= 98 Hydraulic length Basin Slope = 0.0 %= 0 ft

Tc method = User Time of conc. (Tc) = 10.00 min
Total precip. = 8.69 in Distribution = Custom

Storm duration = S:\Petry Engineering ResourceHaipedfaytetormwater\Stoff84 Distributions\NJ-Tyr

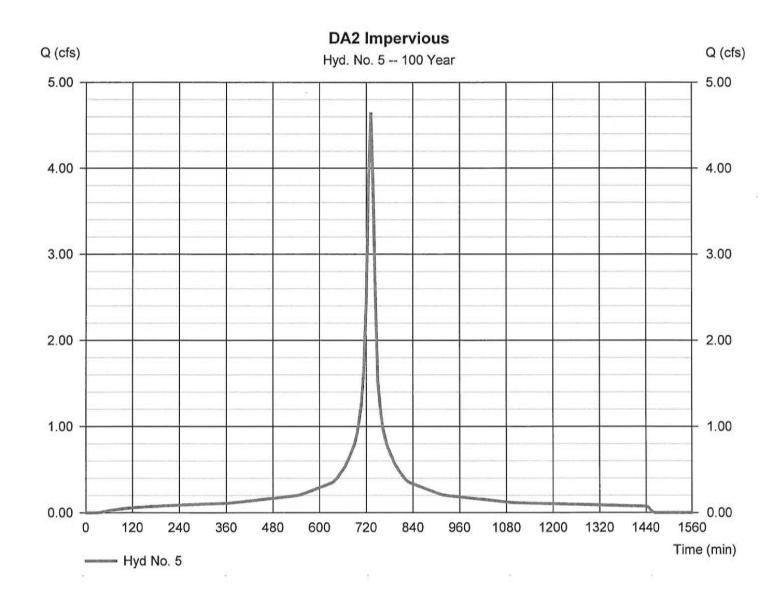

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020

## Hyd. No. 6

<no description>

Hydrograph type Storm frequency Time interval Inflow hyds. = Combine

= 100 yrs = 6 min

= 4, 5


Peak discharge Time to peak = 4.951 cfs

Hyd. volume

= 732 min = 24,443 cuft

Contrib. drain. area

= 0.866 ac

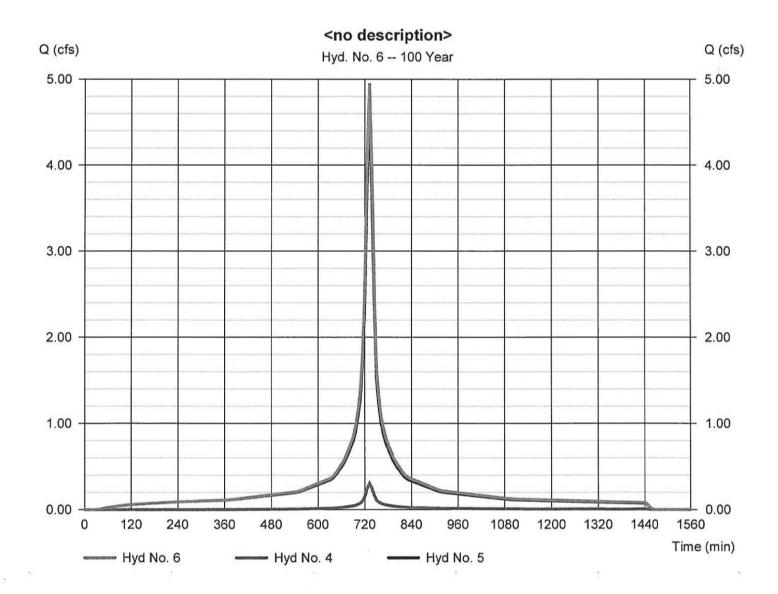

Friday, 03 / 20 / 2020

### Hyd. No. 7

<no description>

Hydrograph type Storm frequency Time interval Inflow hyds. = Combine

= 100 yrs = 6 min

= 6 min = 3, 6 Peak discharge


= 8.009 cfs = 732 min

Time to peak Hyd. volume

= 39,493 cuft

Contrib. drain. area

= 0.000 ac

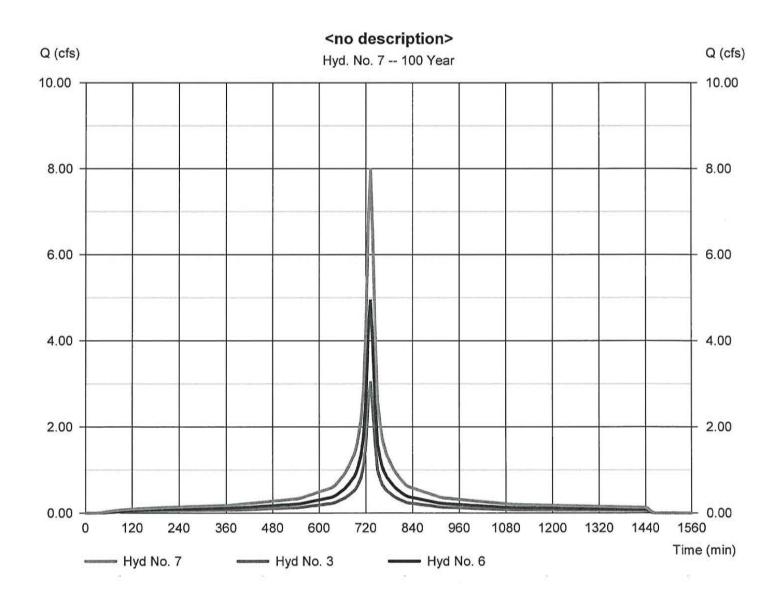

# **Hydraflow Rainfall Report**

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020

Return Period	Intensity-D	uration-Frequency I	Equation Coefficien	ts (FHA)
(Yrs)	В	D	E	(N/A)
1	0.0000	0.0000	0.0000	
2	69.8703	13.1000	0.8658	
3	0.0000	0.0000	0.0000	
5	79.2597	14.6000	0.8369	
10	88.2351	15.5000	0.8279	
25	102.6072	16.5000	0.8217	
50	114.8193	17.2000	0.8199	
100	127.1596	17.8000	0.8186	*******

File name: SampleFHA.idf

#### Intensity = $B / (Tc + D)^E$

Return					Intens	ity Values	s (in/hr)					
Period (Yrs)	5 min	10	15	20	25	30	35	40	45	50	55	60
1	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
2	5.69	4.61	3.89	3.38	2.99	2.69	2.44	2.24	2.07	1.93	1.81	1.70
3	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
5	6.57	5.43	4.65	4.08	3.65	3.30	3.02	2.79	2.59	2.42	2.27	2.15
10	7.24	6.04	5.21	4.59	4.12	3.74	3.43	3.17	2.95	2.77	2.60	2.46
25	8.25	6.95	6.03	5.34	4.80	4.38	4.02	3.73	3.48	3.26	3.07	2.91
50	9.04	7.65	6.66	5.92	5.34	4.87	4.49	4.16	3.88	3.65	3.44	3.25
100	9.83	8.36	7.30	6.50	5.87	5.36	4.94	4.59	4.29	4.03	3.80	3.60


Tc = time in minutes. Values may exceed 60.

Precip. file name: Sample.pcp

						riecip. II	ie name: S	ample.pc
		R	ainfall F	recipita	tion Tal	ole (in)		
Storm Distribution	1-yr	2-yr	3-yr	5-yr	10-yr	25-yr	50-yr	100-yr
SCS 24-hour	0.00	0.00	0.00	4.26	0.00	0.00	7.30	0.00
SCS 6-Hr	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Huff-1st	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Huff-2nd	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Huff-3rd	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Huff-4th	0.00	0.00	0.00	0.00	.0.00	0.00	0.00	0.00
Huff-Indy	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Custom	1.25	3.39	0.00	0.00	5.18	6.42	0.00	8.69

# HYDROGRAPH PROPOSED CONDITIONS

# Watershed Model Schematic Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

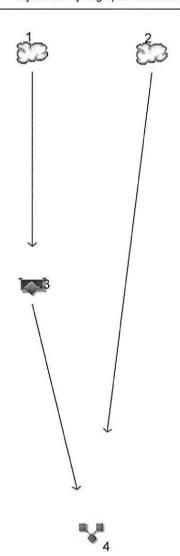

#### Legend

Hyd.	Origin	Description
1	SCS Runoff	Impervious to Basin
2	SCS Runoff	Impervious Bypass
3	Reservoir	Basin
4	Combine	<no description=""></no>

Project: Proposed Revised.gpw

Friday, 03 / 20 / 2020

Friday, 03 / 20 / 2020

Watershed Model Schematic	1
Hydrograph Return Period Recap	2
2 - Year Summary Report	4 5 6 7
10 - Year Summary Report	10 10 11 12
25 - Year Summary Report	15 16 17
100 - Year Summary Report	20 21 21 22
IDF Report	24

Hydrograph Return Period Recap Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

lyd.	Hydrograph	Inflow		270	25	Peak Out	flow (cfs	)	W		Hydrograph
lo.	type (origin)	hyd(s)	1-yr	2-yr	3-yr	5-yr	10-yr	25-yr	50-yr	100-yr	Description
1	SCS Runoff		*****	2.132			3.279	4.072		5.521	Impervious to Basin
2	SCS Runoff			1.000			1.538	1.910		2.590	Impervious Bypass
3	Reservoir	1		0.596			2.106	3.061		4.265	Basin
4	Combine	2, 3		1.491			3.203	4.576		6.366	<no description=""></no>
		ų:			180			SI.			¥ a

Proj. file: Proposed Revised.gpw

Friday, 03 / 20 / 2020

Hydrograph Summary Report
Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)		Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description
1	SCS Runoff	2.132	6	732	10,260				Impervious to Basin
2	SCS Runoff	1.000	6	732	4,813				Impervious Bypass
3	Reservoir	0.596	6	756	10,254	1	152.02	2,765	Basin
4	Combine	1.491	6	732	15,067	2, 3			<no description=""></no>
	,								
Pro	posed Revise	ed.gpw			Return F	Period: 2 Y	ear	Friday, 03	/ 20 / 2020


Friday, 03 / 20 / 2020

# Hyd. No. 1

Impervious to Basin

= SCS Runoff Peak discharge = 2.132 cfsHydrograph type Storm frequency Time to peak = 732 min = 2 yrsTime interval Hyd. volume = 10,260 cuft= 6 min Curve number Drainage area = 0.955 ac= 98 Hydraulic length = 0 ftBasin Slope = 0.0 %Time of conc. (Tc) Tc method = User  $= 10.00 \, \text{min}$ Total precip. = 3.39 inDistribution = Custom

Storm duration = S:\Petry Engineering ResourceHaipeafaytetormwater\Stormwater

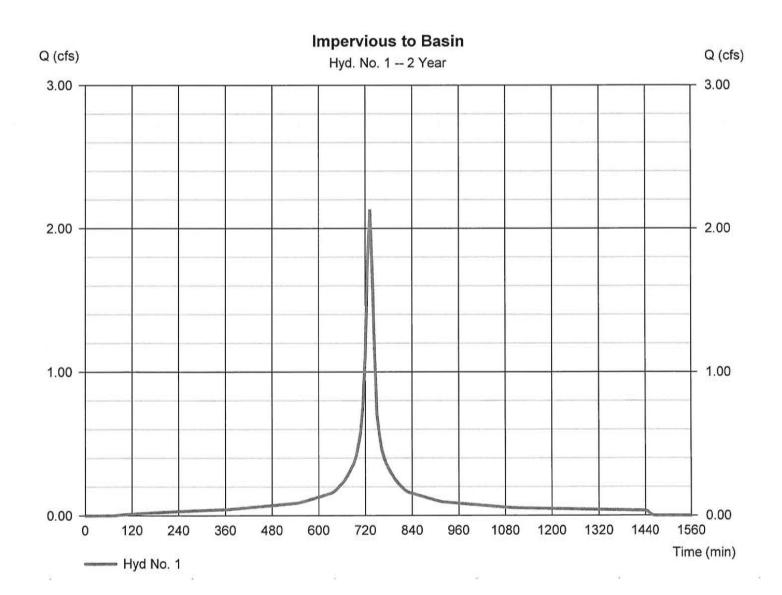

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 03 / 20 / 2020

## Hyd. No. 2

Impervious Bypass

Hydrograph type = SCS Runoff Peak discharge = 1.000 cfsStorm frequency Time to peak = 2 yrs = 732 min Hyd. volume Time interval = 6 min = 4,813 cuft Curve number Drainage area = 0.448 ac= 98 Basin Slope = 0.0 %Hydraulic length = 0 ftTc method = User Time of conc. (Tc)  $= 10.00 \, \text{min}$ Distribution Total precip. = 3.39 in= Custom

Storm duration = S:\Petry Engineering ResourceHaipeafactormwater\S

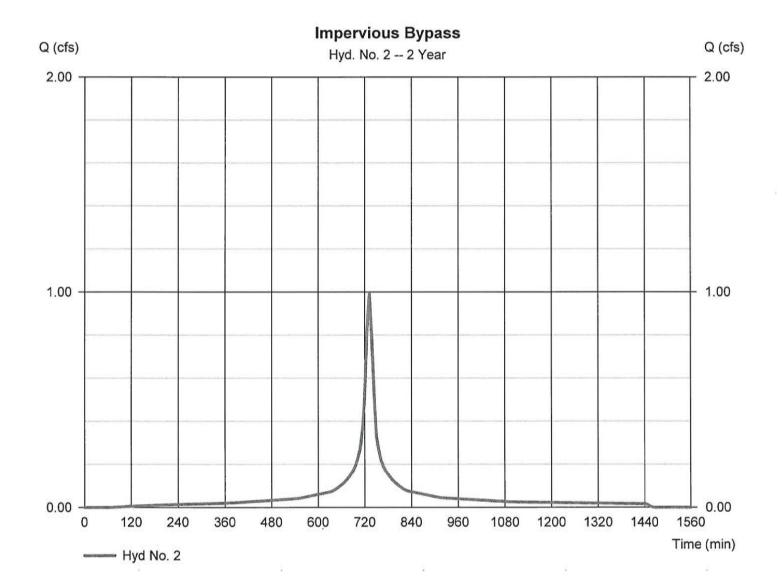

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 03 / 20 / 2020

## Hyd. No. 3

Basin

Hydrograph type Peak discharge = 0.596 cfs= Reservoir Storm frequency = 2 yrs Time to peak = 756 min Time interval Hyd. volume = 6 min = 10,254 cuft = 1 - Impervious to Basin Max. Elevation Inflow hyd. No.  $= 152.02 \, \text{ft}$ Reservoir name = Detention Basin Max. Storage = 2,765 cuft

Storage Indication method used.

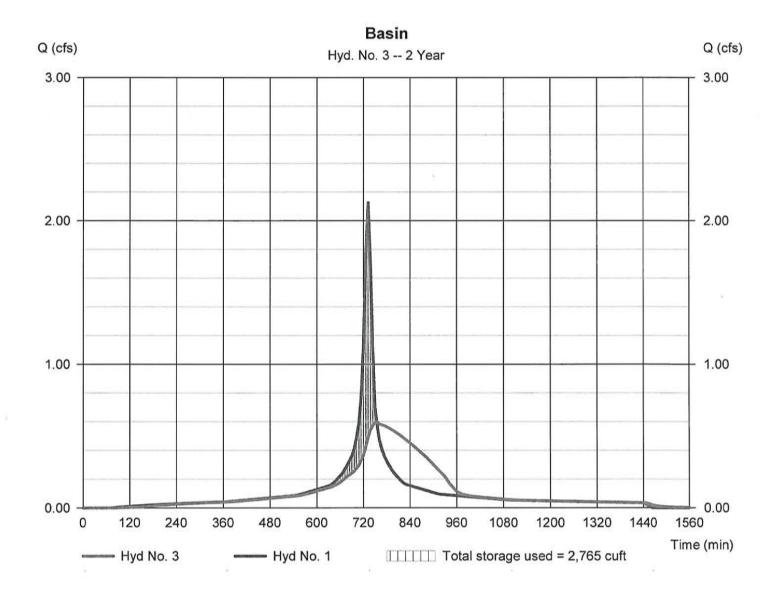

Friday, 03 / 20 / 2020

#### Pond No. 1 - Detention Basin

#### **Pond Data**


UG Chambers -Invert elev. = 150.50 ft, Rise x Span = 3.00 x 3.00 ft, Barrel Len = 250.00 ft, No. Barrels = 3, Slope = 0.00%, Headers = Yes

#### Stage / Storage Table

Stage (ft)	Elevation (ft)	Contour area (sqft)	Incr. Storage (cuft)	Total storage (cuft)
0.00	150.50	n/a	0	0
0.30	150.80	n/a	285	285
0.60	151.10	n/a	494	780
0.90	151.40	n/a	602	1,381
1.20	151.70	n/a	663	2,044
1.50	152.00	n/a	693	2,737
1.80	152.30	n/a	692	3,429
2.10	152.60	n/a	663	4,092
2.40	152.90	n/a	601	4,693
2.70	153.20	n/a	494	5,188
3.00	153.50	n/a	284	5,472

Culvert / Ori	fice Structu	res			Weir Structures					
	[A]	[B]	[C]	[PrfRsr]		[A]	[B]	[C]	[D]	
Rise (in)	= 2.50	6.00	0.00	0.00	Crest Len (ft)	= 4.00	0.00	0.00	0.00	
Span (in)	= 2.50	20.00	0.00	0.00	Crest El. (ft)	= 153.17	0.00	0.00	0.00	
No. Barrels	= 3	1	0	0	Weir Coeff.	= 3.33	3.33	3.33	3.33	
Invert El. (ft)	= 150.50	152.00	0.00	0.00	Weir Type	= Rect				
Length (ft)	= 0.00	0.00	0.00	0.00	Multi-Stage	= No	No	No	No	
Slope (%)	= 0.00	0.00	0.00	n/a						
N-Value	= .013	.013	.013	n/a						
Orifice Coeff.	= 0.60	0.60	0.60	0.60	Exfil.(in/hr)	= 0.000 (by	Wet area	)		
Multi-Stage	= n/a	No	No	No	TW Elev. (ft)	= 0.00				

Note: Culvert/Orifice outflows are analyzed under inlet (ic) and outlet (oc) control. Weir risers checked for orifice conditions (ic) and submergence (s).

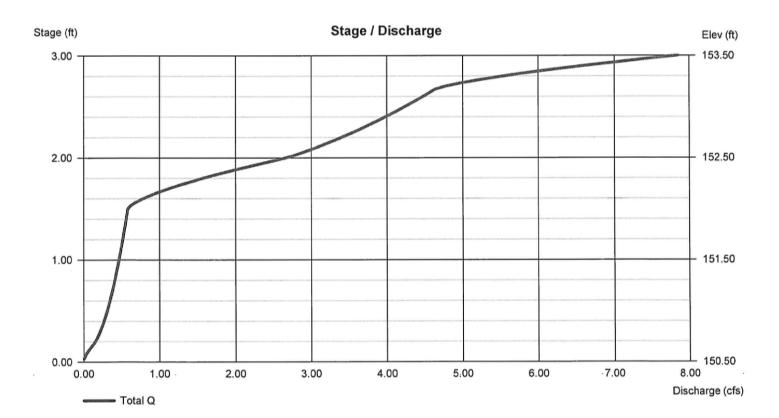


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020

# Hyd. No. 4

<no description>

Hydrograph type = Combine Storm frequency = 2 yrs Time interval = 6 min Inflow hyds. = 2, 3 Peak discharge = 1.491 cfs
Time to peak = 732 min
Hyd. volume = 15,067 cuft
Contrib. drain. area = 0.448 ac

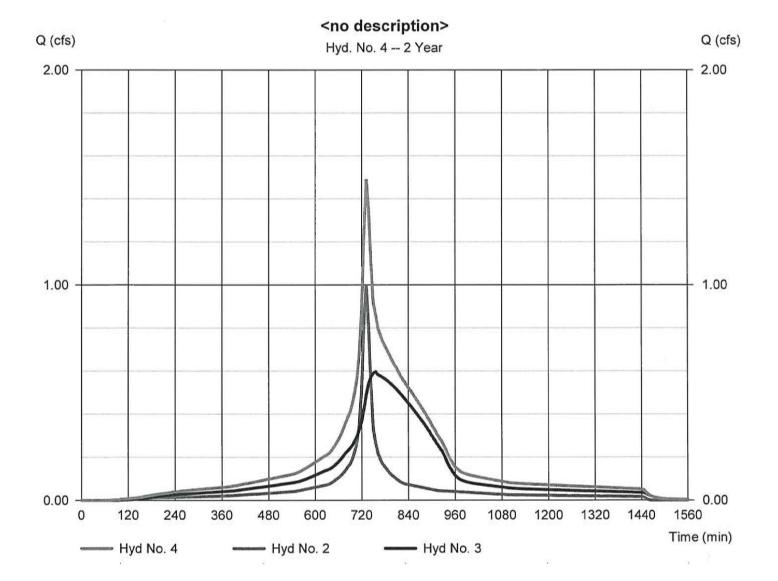

Hydrograph Summary Report
Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description
1 2	SCS Runoff	3.279 1.538	6	732 732	16,064 7,536				Impervious to Basin Impervious Bypass
3	Reservoir	2.106	6	744	16,059	1	152.43	3,654	Basin
4	Combine	3.203	6	738	23,595	2, 3			<no description=""></no>
	Al .		76	,		ψ)		765	(A)
Proposed Revised.gpw					Return I	Period: 10	Year	Friday, 03	/ 20 / 2020


Friday, 03 / 20 / 2020

# Hyd. No. 1

Impervious to Basin

= 3.279 cfsHydrograph type = SCS Runoff Peak discharge Time to peak Storm frequency = 732 min = 10 yrsHyd. volume Time interval = 6 min = 16,064 cuft Curve number = 98 Drainage area = 0.955 acHydraulic length Basin Slope = 0.0 %= 0 ftTime of conc. (Tc)  $= 10.00 \, \text{min}$ Tc method = User Distribution Total precip. = 5.18 in= Custom

Storm duration = S:\Petry Engineering Resourcehaipeafay\text{Stormwater\Storm

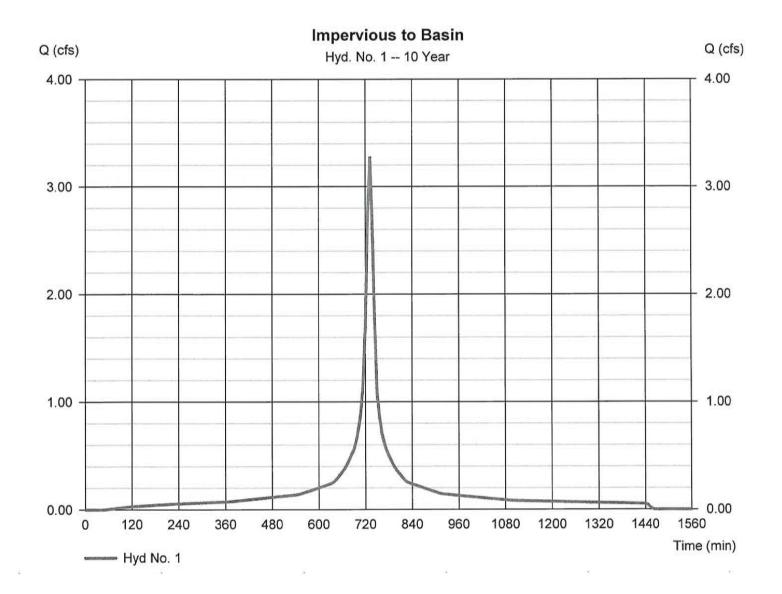


Friday, 03 / 20 / 2020

# Hyd. No. 2

Impervious Bypass

Hydrograph type = SCS Runoff Peak discharge = 1.538 cfsStorm frequency Time to peak = 10 yrs= 732 min Time interval Hyd. volume = 7,536 cuft= 6 min Curve number Drainage area = 0.448 ac = 98 Basin Slope = 0.0 %Hydraulic length = 0 ftTime of conc. (Tc) Tc method = User  $= 10.00 \, \text{min}$ Total precip. = 5.18 inDistribution = Custom

Storm duration = S:\Petry Engineering Resource Haipeefay to to mwater\Stormwa

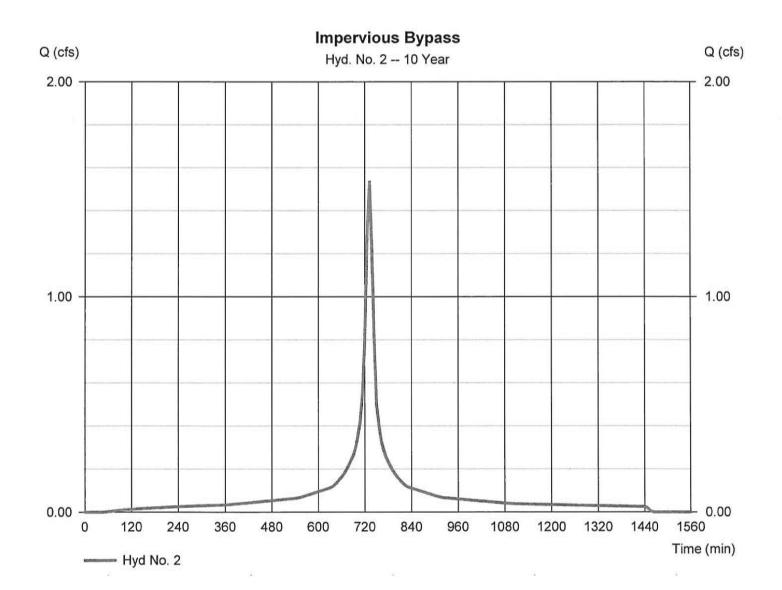

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 03 / 20 / 2020

# Hyd. No. 3

Basin

Hydrograph type = Reservoir Peak discharge = 2.106 cfsStorm frequency Time to peak = 744 min = 10 yrsHyd. volume Time interval = 6 min = 16,059 cuft= 1 - Impervious to Basin Max. Elevation  $= 152.43 \, ft$ Inflow hyd. No. Reservoir name = Detention Basin Max. Storage = 3,654 cuft

Storage Indication method used.

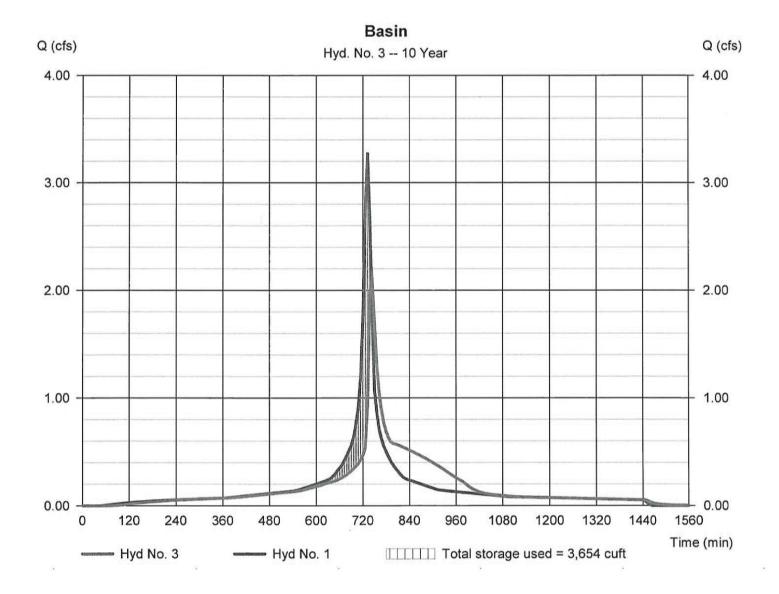


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020

# Hyd. No. 4

<no description>

Hydrograph type = Combine Storm frequency = 10 yrs Time interval = 6 min Inflow hyds. = 2, 3 Peak discharge = 3.203 cfs
Time to peak = 738 min
Hyd. volume = 23,595 cuft
Contrib. drain. area = 0.448 ac

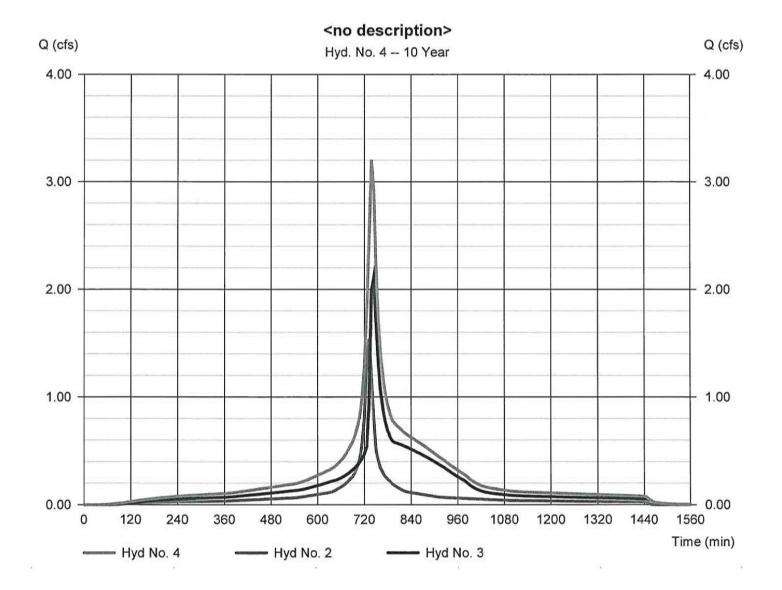

Hydrograph Summary Report
Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description
1	SCS Runoff	4.072	6	732	20,089		*****		Impervious to Basin
2	SCS Runoff	1.910	6	732	9,424				Impervious Bypass
3	Reservoir	3.061	6	738	20,084	1	152.61	4,087	Basin
4	Combine	4.576	6	738	29,508	2, 3		******	<no description=""></no>
			,	,					
Pro	posed Revise	ed apw			Return 5	Period: 25	Vear	Friday, 03	/ 20 / 2020


Friday, 03 / 20 / 2020

### Hyd. No. 1

Impervious to Basin

Hydrograph type = SCS Runoff Peak discharge = 4.072 cfsStorm frequency Time to peak = 25 yrs= 732 min Time interval Hyd. volume = 6 min = 20,089 cuftCurve number Drainage area = 0.955 ac= 98 Hydraulic length Basin Slope = 0.0 %= 0 ftTc method Time of conc. (Tc)  $= 10.00 \, \text{min}$ = User Total precip. Distribution = Custom = 6.42 in

Storm duration = S:\Petry Engineering Resourcehaipeefaytetormwater\Stoff84 Distributions\NJ-Tyr

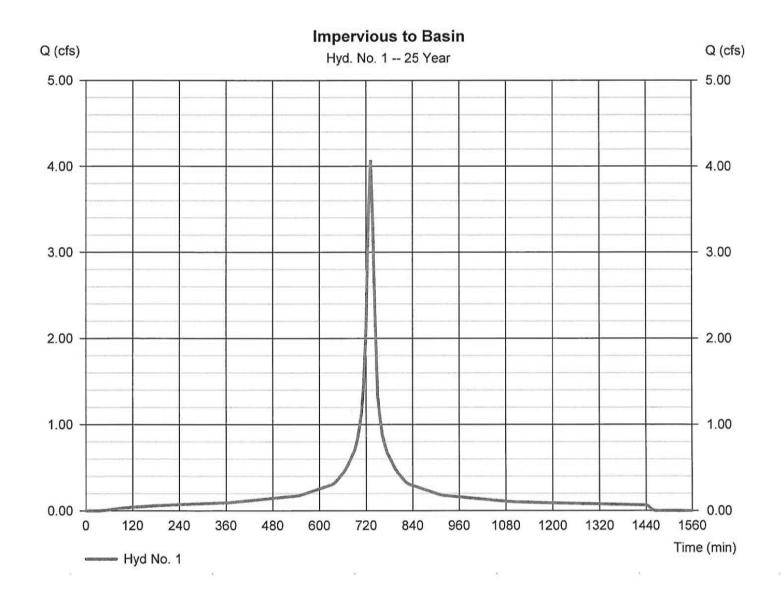


Friday, 03 / 20 / 2020

## Hyd. No. 2

Impervious Bypass

Hydrograph type = SCS Runoff Peak discharge = 1.910 cfsStorm frequency Time to peak = 25 yrs = 732 min Time interval Hyd. volume = 6 min = 9,424 cuft Curve number Drainage area = 0.448 ac= 98 Basin Slope = 0.0 %Hydraulic length = 0 ftTime of conc. (Tc) Tc method = User  $= 10.00 \, \text{min}$ Total precip. Distribution = 6.42 in= Custom

Storm duration = S:\Petry Engineering Resourcehalpering Resourceha

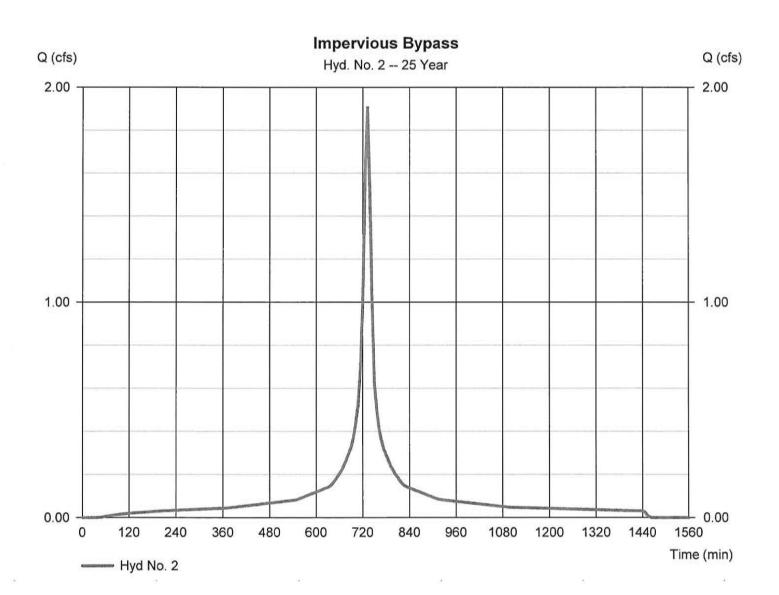

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020

# Hyd. No. 3

Basin

Hydrograph type

= Reservoir

Peak discharge

= 3.061 cfs

Storm frequency Time interval

= 25 yrs

Time to peak

= 738 min = 20,084 cuft

Inflow hyd. No.

= 6 min

Hyd. volume Max. Elevation

= 152.61 ft


Reservoir name

1 - Impervious to BasinDetention Basin

Max. Storage

= 4,087 cuft

Storage Indication method used.

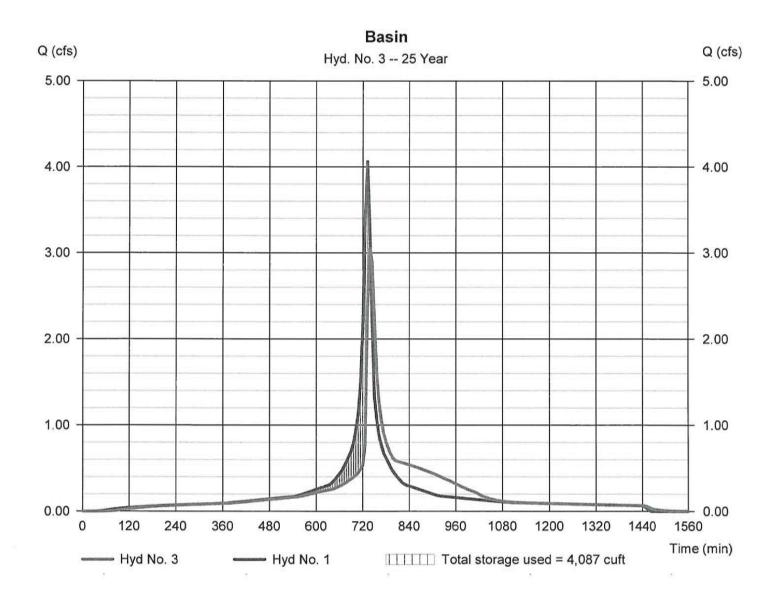

Friday, 03 / 20 / 2020

### Hyd. No. 4

<no description>

Hydrograph type Storm frequency

= Combine

Peak discharge Time to peak = 4.576 cfs

Time interval

= 25 yrs = 6 min

Time to peak Hyd. volume


= 738 min = 29,508 cuft

Inflow hyds.

= 2, 3

Contrib. drain. area

= 0.448 ac

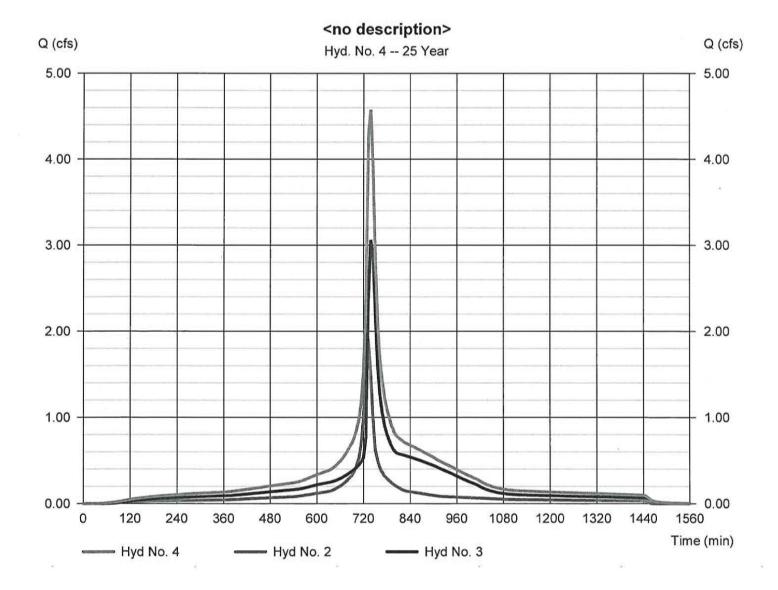

# Hydrograph Summary Report Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description
1	SCS Runoff	5.521	6	732	27,462				Impervious to Basin
2	SCS Runoff	2.590	6	732	12,883				Impervious Bypass
3	Reservoir	4.265	6	738	27,456	1	153.02	4,877	Basin
	Combine	6.366	6	732	40,339	2, 3			<no description=""></no>
Pro	posed Revise	ed.gpw			Return P	eriod: 100	Year	Friday, 03	20 / 2020


Friday, 03 / 20 / 2020

### Hyd. No. 1

Impervious to Basin

Hydrograph type = SCS Runoff Peak discharge = 5.521 cfsStorm frequency Time to peak = 100 yrs= 732 min Time interval = 6 min Hyd. volume = 27,462 cuft Curve number Drainage area = 0.955 ac= 98 Hydraulic length Basin Slope = 0.0 % = 0 ftTc method Time of conc. (Tc) = User  $= 10.00 \, \text{min}$ Total precip. = 8.69 inDistribution = Custom

Storm duration = S:\Petry Engineering Resourcehaipeefaytetormwater\Stoff84 Distributions\NJ-Tyr

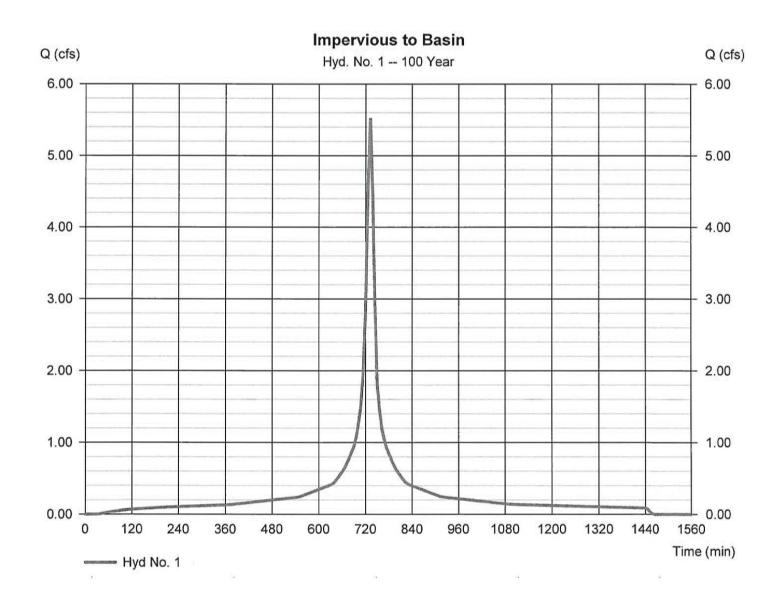


Friday, 03 / 20 / 2020

### Hyd. No. 2

### Impervious Bypass

Hydrograph type = SCS Runoff Peak discharge = 2.590 cfsStorm frequency Time to peak = 732 min = 100 yrs Hyd. volume Time interval = 12,883 cuft = 6 min Curve number Drainage area = 98 = 0.448 acHydraulic length Basin Slope = 0.0 % = 0 ftTime of conc. (Tc) Tc method = User  $= 10.00 \, \text{min}$ Total precip. Distribution = 8.69 in= Custom

Storm duration = S:\Petry Engineering Resource Halperfay & Bromwater\Stormwat

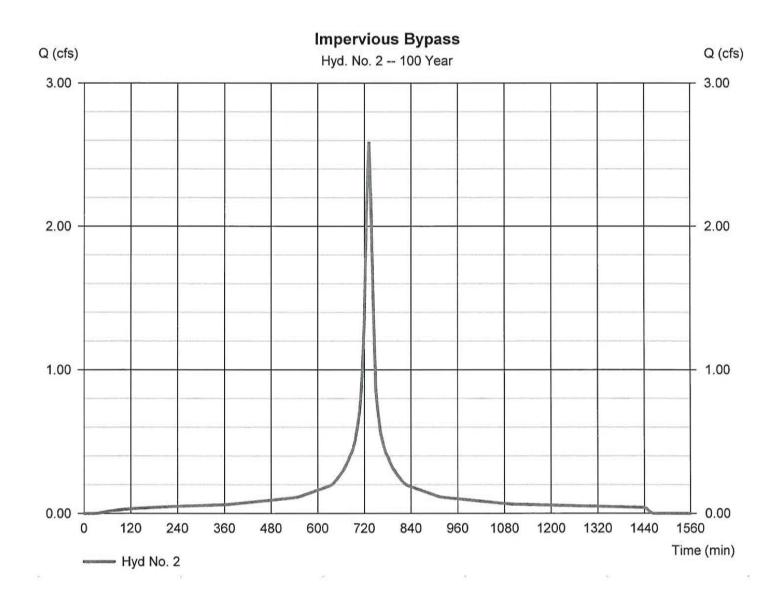

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 03 / 20 / 2020

### Hyd. No. 3

Basin

Hydrograph type Peak discharge = 4.265 cfs= Reservoir Storm frequency Time to peak = 100 yrs= 738 min Time interval = 6 min Hyd. volume = 27,456 cuft = 1 - Impervious to Basin Max. Elevation Inflow hyd. No.  $= 153.02 \, \text{ft}$ = Detention Basin Max. Storage Reservoir name = 4,877 cuft

Storage Indication method used.

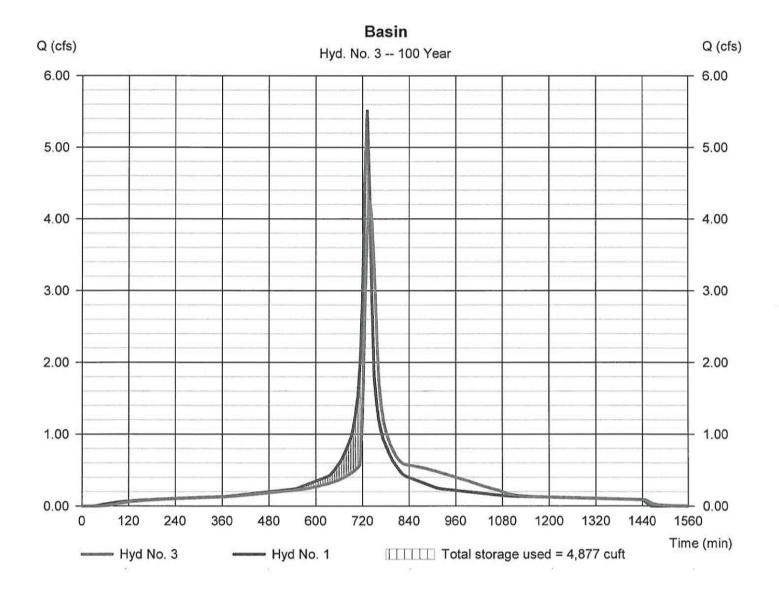


Friday, 03 / 20 / 2020

### Hyd. No. 4

<no description>

Hydrograph type = Combine Storm frequency = 100 yrs Time interval = 6 min Inflow hyds. = 2, 3 Peak discharge = 6.366 cfs
Time to peak = 732 min
Hyd. volume = 40,339 cuft
Contrib. drain. area = 0.448 ac

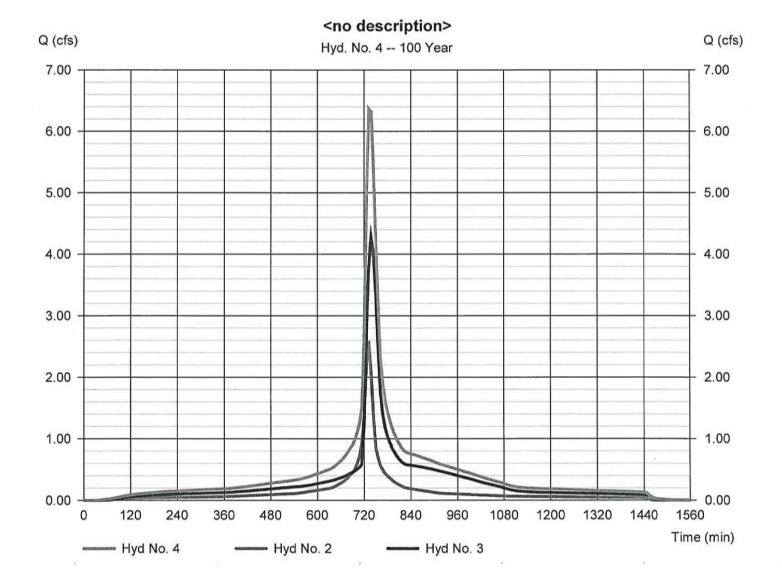

# **Hydraflow Rainfall Report**

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 03 / 20 / 2020

Return Period	Intensity-Duration-Frequency Equation Coefficients (FHA)								
(Yrs)	В	D	E	(N/A)					
1	0.0000	0.0000	0.0000						
2	69.8703	13.1000	0.8658						
3	0.0000	0.0000	0.0000	*******					
5	79.2597	14.6000	0.8369						
10	88.2351	15.5000	0.8279	******					
25	102.6072	16.5000	0.8217						
50	114.8193	17.2000	0.8199						
100	127.1596	17.8000	0.8186						
100	127.1596	17.8000	0.8186						

File name: SampleFHA.idf

#### Intensity = B / (Tc + D)^E

Return Period (Yrs)	Intensity Values (in/hr)											
	5 min	10	15	20	25	30	35	40	45	50	55	60
1	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
2	5.69	4.61	3.89	3.38	2.99	2.69	2.44	2.24	2.07	1.93	1.81	1.70
3	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
5	6.57	5.43	4.65	4.08	3.65	3.30	3.02	2.79	2.59	2.42	2.27	2.15
10	7.24	6.04	5.21	4.59	4.12	3.74	3.43	3.17	2.95	2.77	2.60	2.46
25	8.25	6.95	6.03	5.34	4.80	4.38	4.02	3.73	3.48	3.26	3.07	2.91
50	9.04	7.65	6.66	5.92	5.34	4.87	4.49	4.16	3.88	3.65	3.44	3.25
100	9.83	8.36	7.30	6.50	5.87	5.36	4.94	4.59	4.29	4.03	3.80	3.60

Tc = time in minutes. Values may exceed 60.

Precip. file name: S:\Petry Engineering Cad Projects\2019\19 0078 Lustbader - 52-62 Taylor Place\Rainfall.pcp

	Rainfall Precipitation Table (in)									
Storm Distribution	1-yr	2-yr	3-yr	5-yr	10-yr	25-yr	50-yr	100-yr		
SCS 24-hour	0.00	0.00	0.00	4.26	0.00	0.00	7.30	0.00		
SCS 6-Hr	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
Huff-1st	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
Huff-2nd	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
Huff-3rd	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
Huff-4th	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
Huff-Indy	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
Custom	1.25	3.39	0.00	0.00	5.18	6.42	0.00	8.69		